


VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

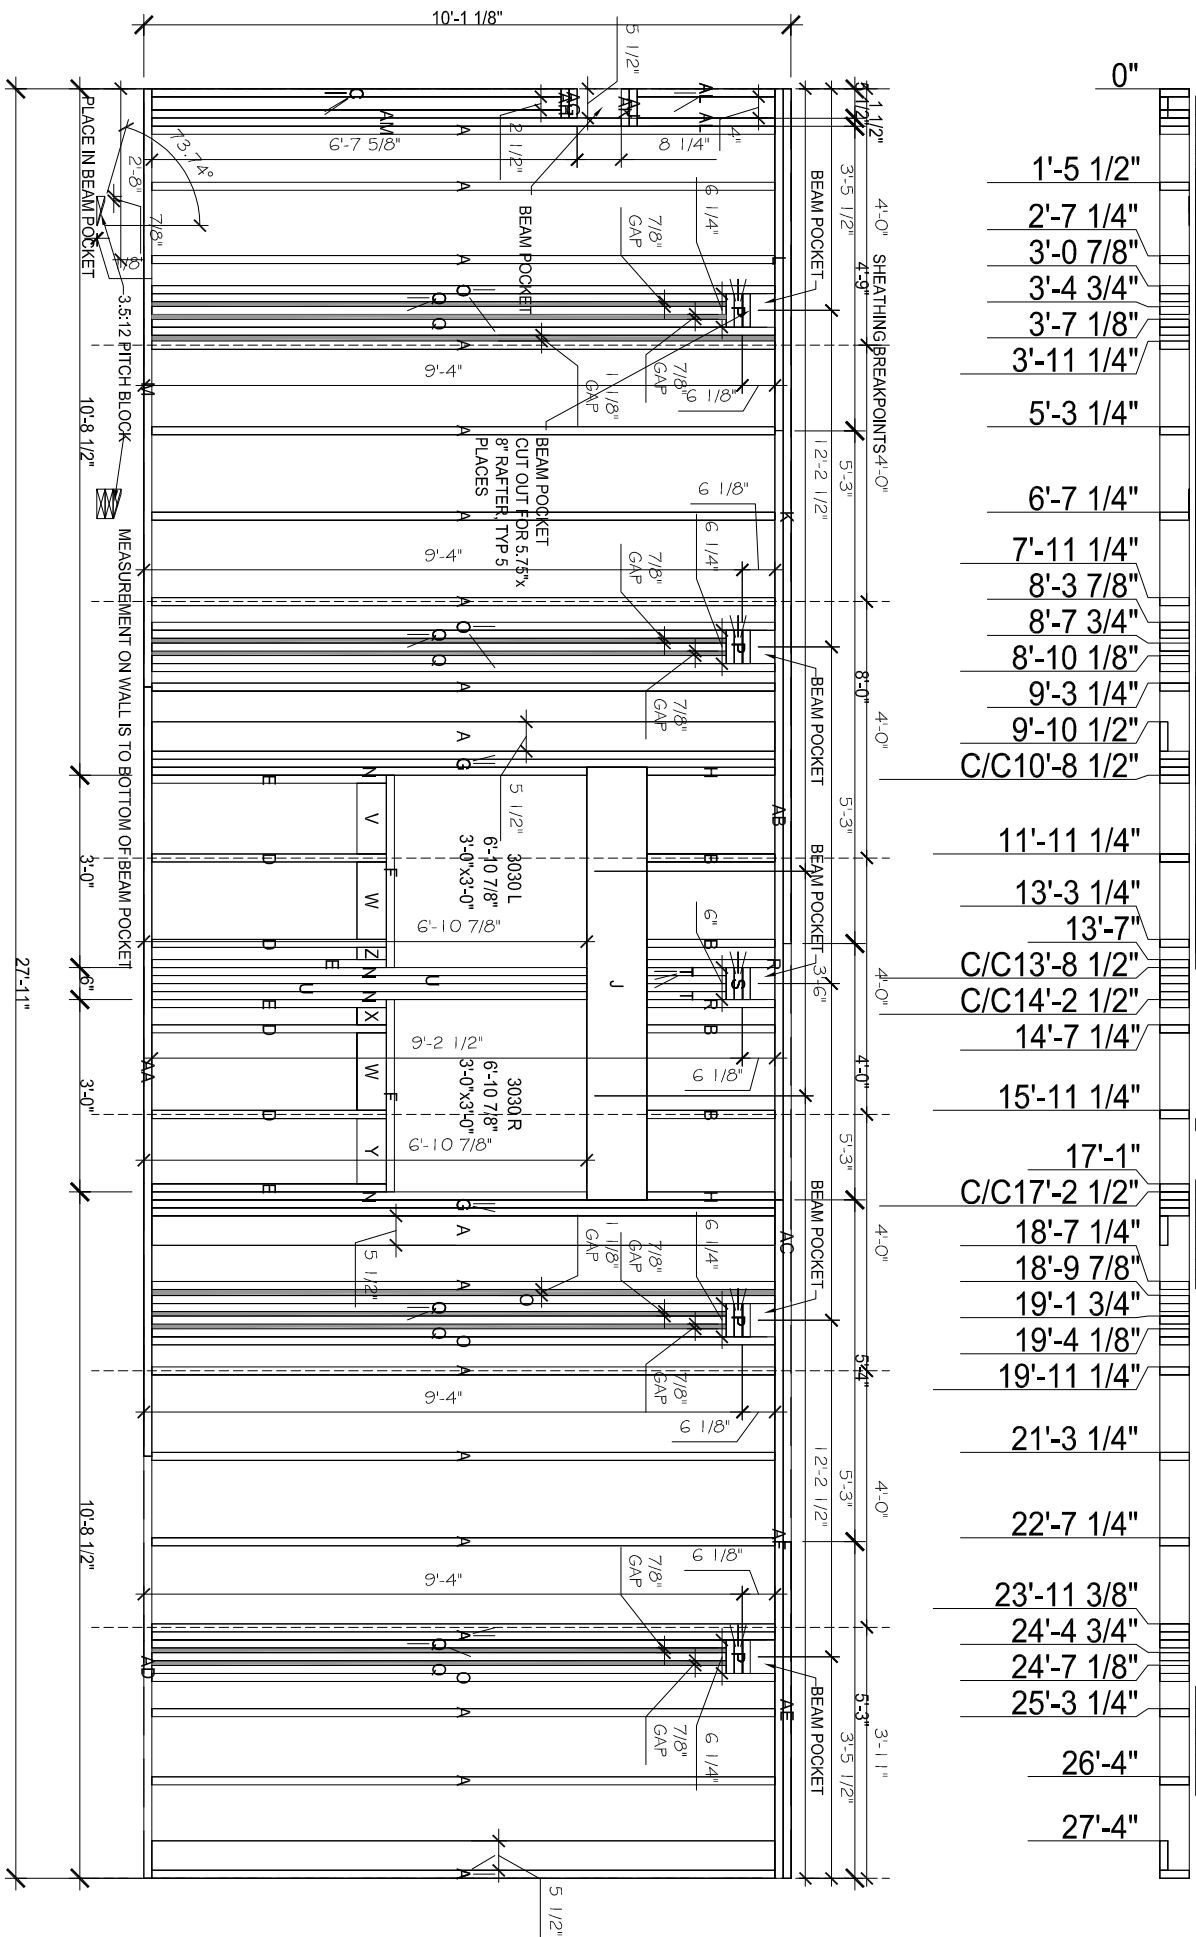

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

LAYOUT.


NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2, OR BETTER UNLESS OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON THE EDGES AND 12" ON THE FIELD, U.N.O. STAGGER NAILS @ PANEL EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY DIFFERENCE BY .01 OF A DEGREE

FOR MULT MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B



ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING PAPER 6" BELOW BOTTOM OF THE WALL

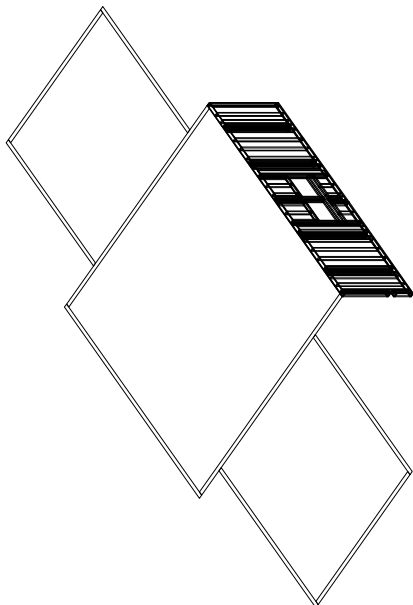

Material (Length is to longest points)										Material (Length is to longest points)									
Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2	Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2
Timber	2x6	K	1		13'-4"					Stud	2x6	T	4		1'-2 7/8"				
VTP	2x6	L	1		5'-4"					Stud	2x6	U	2		6'-9 3/8"				
Top Plate	2x6	M	1		9'-4"					Stud	2x6	AL	3		2'-1 13/16"				
Bottom Plate	2x6	AA	1		12'-0"					Stud	2x6	AM	1		7'-3 7/8"				
Bottom Plate	2x6	AB	1		12'-0"					King	2x6	O	7		9'-8 5/8"				
Top Plate	2x6	AC	1		9'-4"					King	2x6	R	2		2'-0"				
VTP	2x6	AD	1		6'-7"					Sill Cripple Filler	1 1/2"x5 1/2"	E	4		3'-7 7/8"				
Bottom Plate	2x6	AE	1		5'-3"					King Filler	1 1/2"x5 1/2"	G	4		9'-8 5/8"				
VTP	2x6	AF	1		10'-7"					Hdt Cripple Filler	1 1/2"x5 1/2"	H	2		2'-0"				
Top Plate	2x6	AG	1		5 1/2"					2-2x12 - Insulation Core	5 1/2"x11 1/4"	J	1		6'-9"				
VTP	2x6	AH	1		5 1/2"					Jack Filler	1 1/2"x5 1/2"	N	4		6'-9 3/8"				
Top Plate	2x6	AJ	1		7"					Unknown	2x6	P	12		6 1/4"				
VTP	2x6	AK	1		7"					Unknown	2x6	S	3		6"				
Top Plate	2x6	F	2		3'-0"					Blocking	2x6	V	1		1'-1 1/4"				
Sill	2x6	D	4		3'-7 7/8"					Blocking	2x6	W	2		1'-2 1/2"				
Sill Cripple	2x6	B	4		2'-0"					Blocking	2x6	X	1		3 1/4"				
Hdt Cripple	2x6	A	20		9'-8 5/8"					Blocking	2x6	Y	1		1'-0 1/4"				
Stud	2x6	C	3		6'-4 5/8"					Blocking	2x6	Z	1		2 1/4"				
Stud	2x6	Q	12		8'-11 1/2"					Blocking	2x6								

 Whisper Creek By Rocky Mountain Homes	Project #:	7014-000	Date:		December 12, 2017
	Project Name:	MEYER	Drawn By:	Wall Location:	Wall #:
	Project Style:		CRB		
			MANG.		A-CF-10-28-V1

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

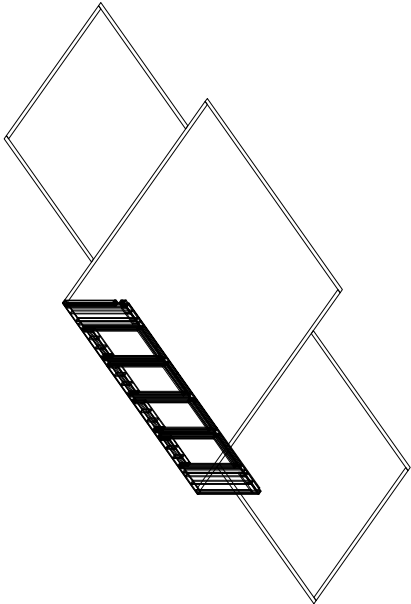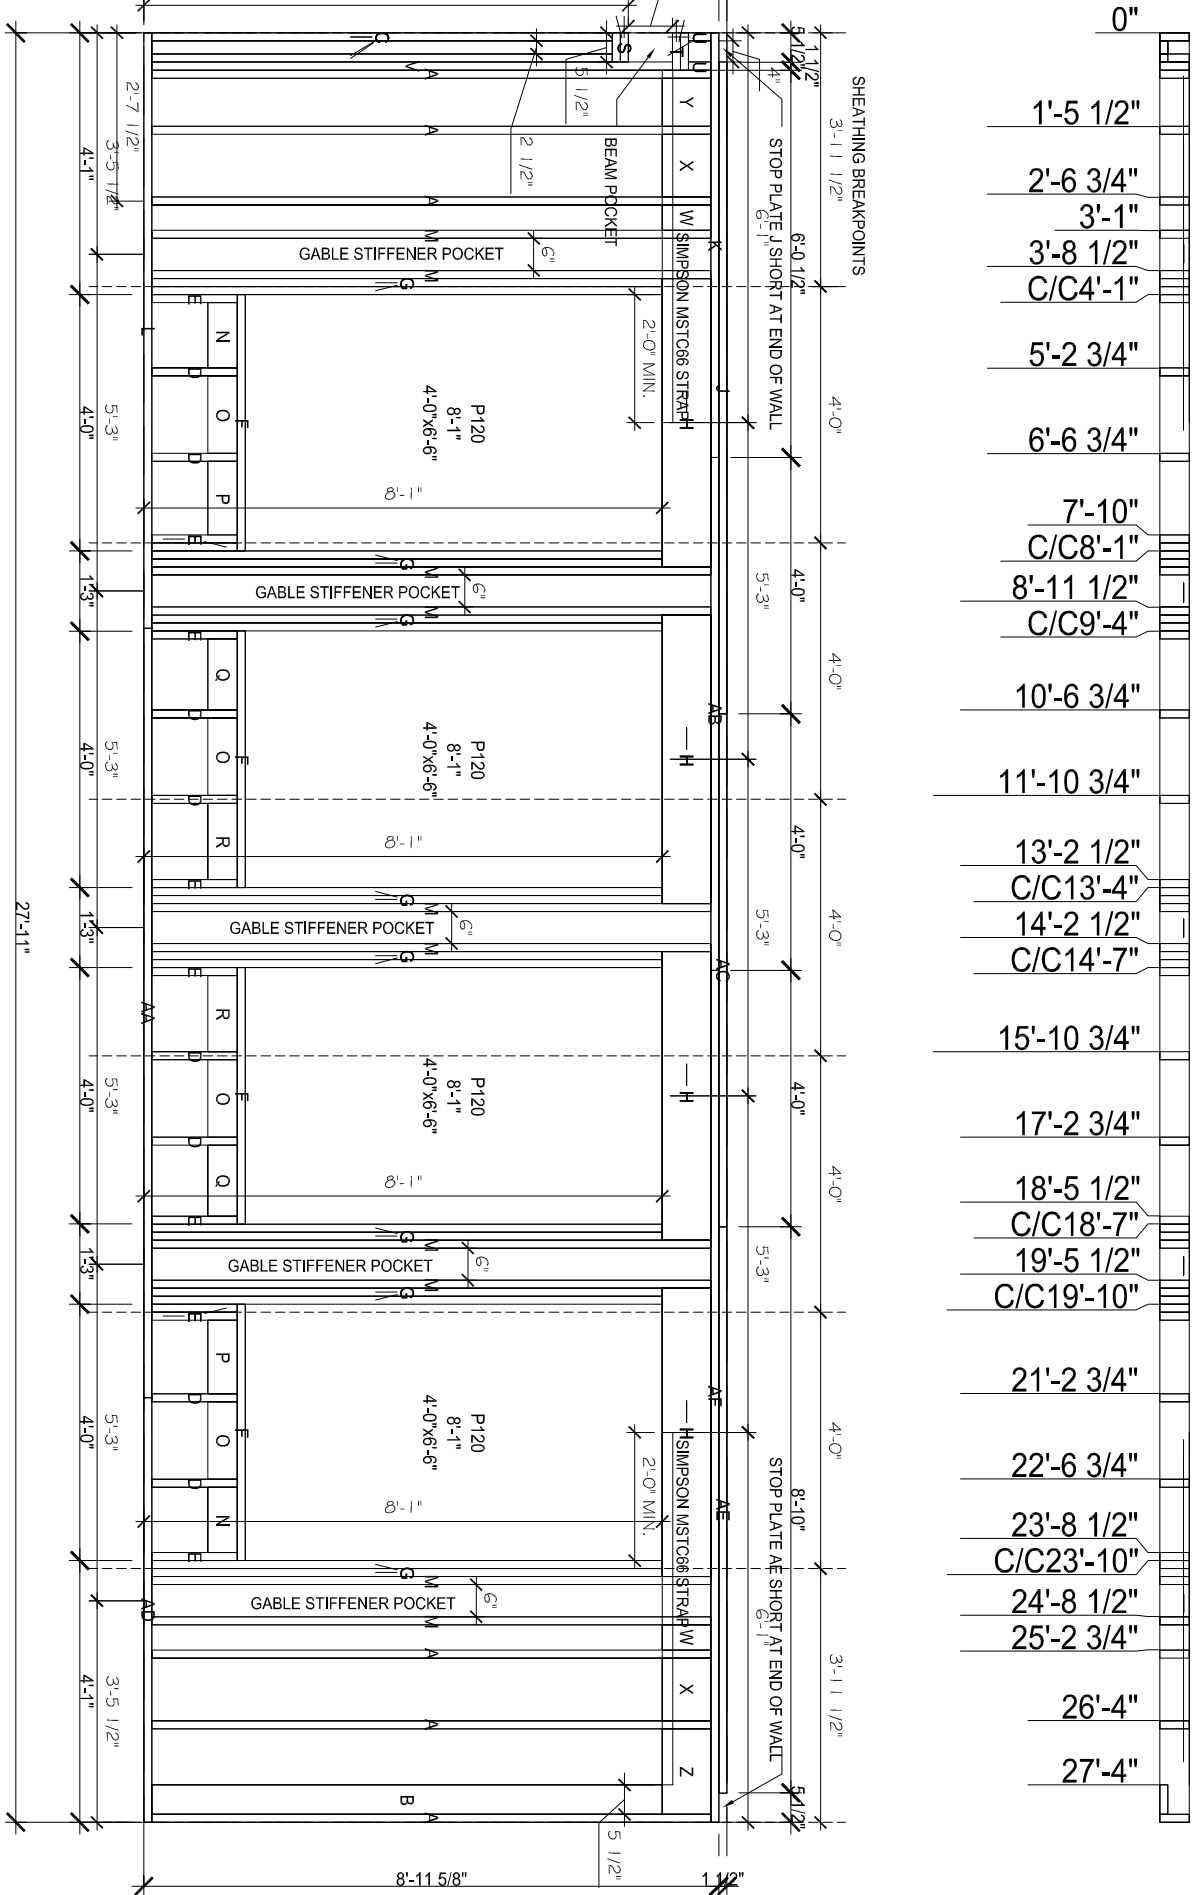

NOTE: SOME FACE STUDS NEED TO BE RIPPED DOWN TO FIT BETWEEN STUDS. WIDTHS ARE DIMENSIONED ON WALL LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C. STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C. EACH SIDE, EACH LAYER
-STAGGERED 1X8

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING PAPER 6" BELOW BOTTOM OF THE WALL

Material (Length is to longest points)

Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2
VTP	2x6	J	1		10'-2"				Stud
Top Plate	2x6	K	1		6'-7 1/2"				Stud
Bottom Plate	2x6	L	1		9'-3 1/2"				Stud
Top Plate	2x6	S	2		5 1/2"				Stud
Top Plate	2x6	T	2		7"				King
Bottom Plate	2x6	AA	1		12'-0"				Sill Cripple Filler
Top Plate	2x6	AB	1		8'-0"				Jack Filler
VTP	2x6	AC	1		8'-0"				Blocking
Bottom Plate	2x6	AD	1		6'-7 1/2"				Blocking
VTP	2x6	AE	1		8'-10"				Blocking
Top Plate	2x6	AF	1		13'-3 1/2"				Blocking
Sill	2x6	F	4		4'-0"				Blocking
Sill Cripple	2x6	D	8		1'-4"				
LVL	1 3/4"x9 1/8" LVL	H	12		4'-6"				
LVL	1 3/4"x9 1/8" LVL	W	2		4 3/4"				
LVL	1 3/4"x9 1/8" LVL	X	2		11 3/4"				
LVL	1 3/4"x9 1/8" LVL	Y	1		9"				
LVL	1 3/4"x9 1/8" LVL	Z	1		1'-4"				
Stud	2x6	A	6		8'-8 5/8"				

Material (Length is to longest points)

Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2
Stud	2x6	B	1		7'-11 1/2"				
Stud	2x6	C	3		7'-2 3/16"				
Stud	2x6	U	3		4 3/16"				
Stud	2x6	V	1		8'-1 7/16"				
King	2x6	M	10		8'-8 5/8"				
Sill Cripple Filler	1 1/2"x5 1/2"	E	10		1'-4"				
Jack Filler	1 1/2"x5 1/2"	G	16		7'-11 1/2"				
Blocking	2x6	N	2		1'-0 1/4"				
Blocking	2x6	O	4		1'-2 1/2"				
Blocking	2x6	P	2		1'-1 3/4"				
Blocking	2x6	Q	2		1'-1 1/4"				
Blocking	2x6	R	2		1'-2 1/4"				



Whisper Creek

By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Checked By:


MANG.

Wall Location:


Wall #:

B-CB-09-28-V1

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

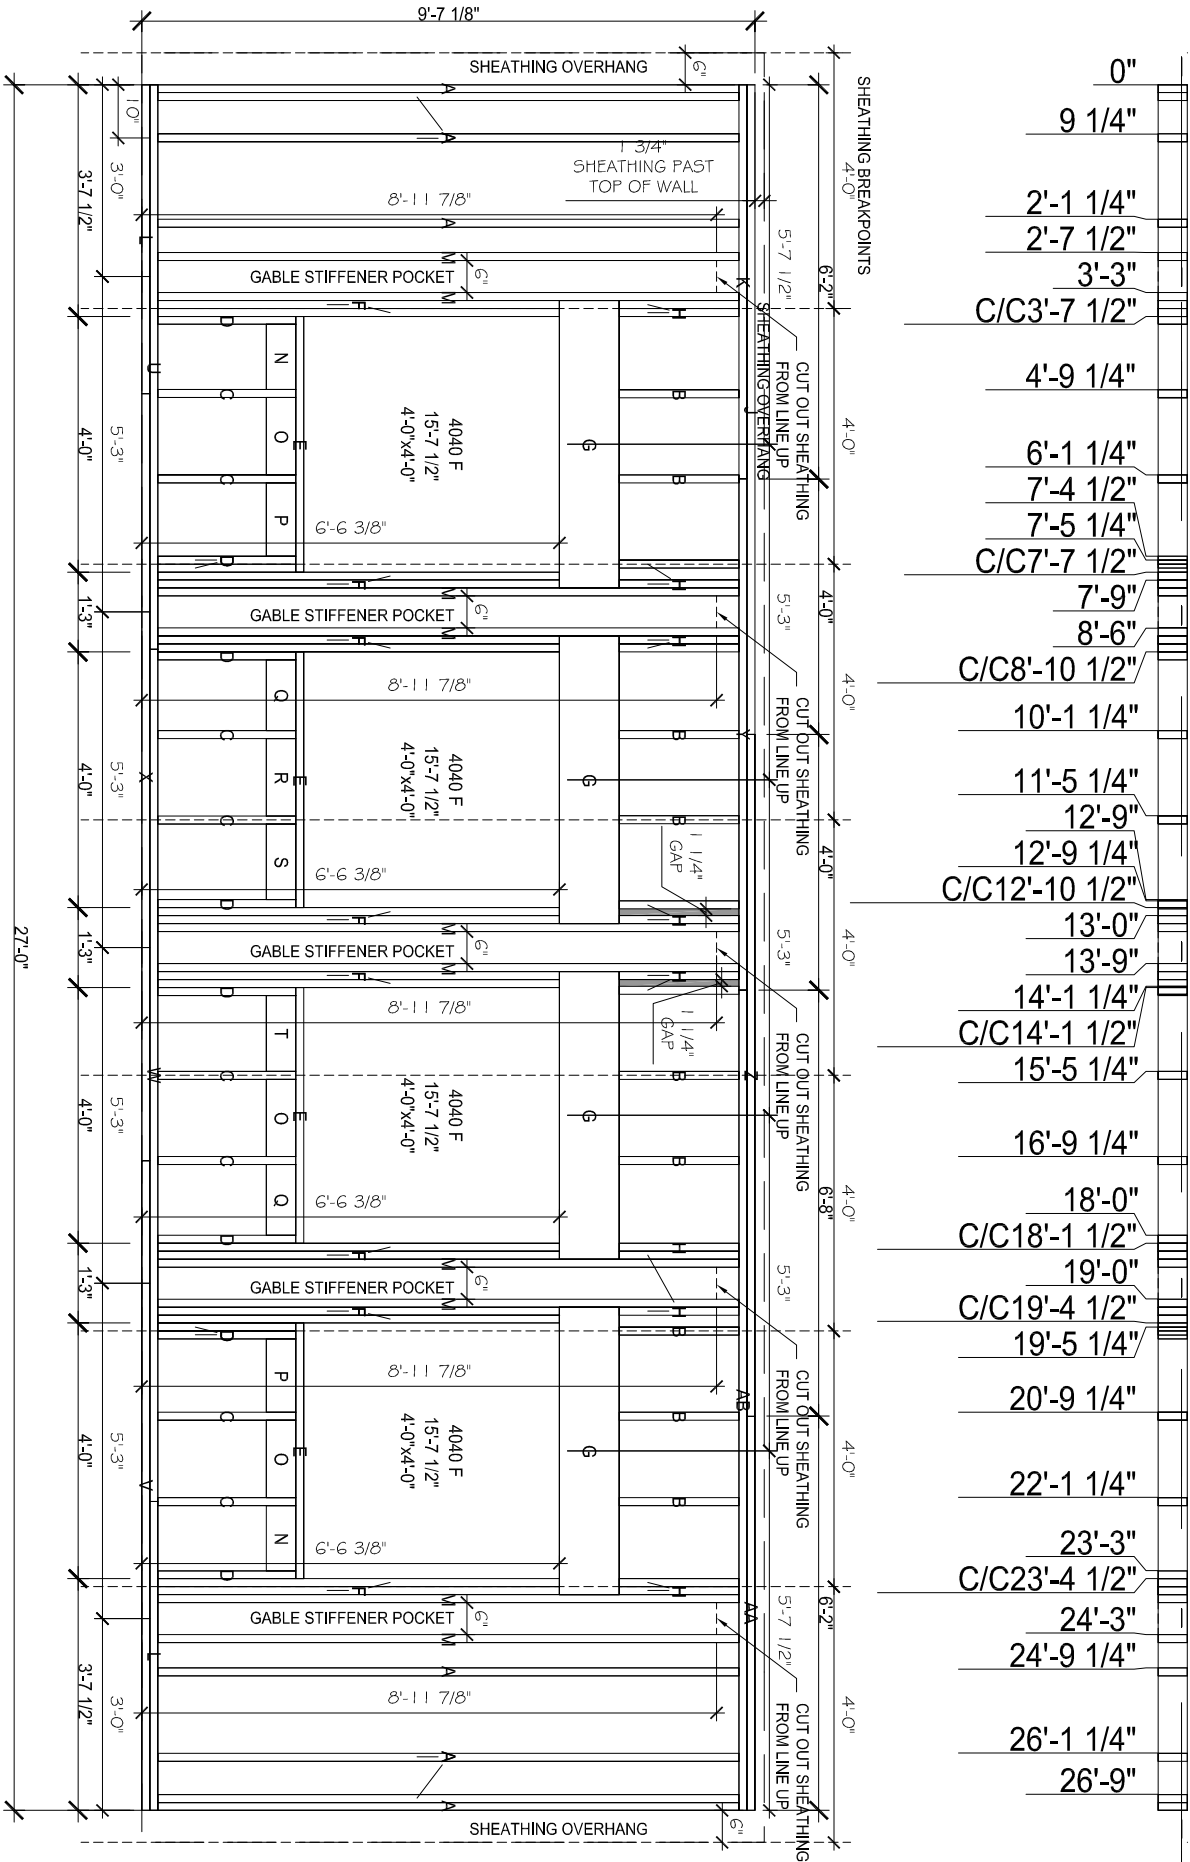

Material (Length is to longest points)						Material (Length is to longest points)					
Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev. 2	Timber	Size
VTP	2x6	J	1		10'-2"					Hdr Cripple Filler	1 1/2"x5 1/2"
Top Plate	2x6	K	1		6'-2"					2x6	2x6
Bottom Plate	2x6	L	2		4'-10"					Blocking	2x6
Bottom Plate	2x6	U	1		8'-10"					Blocking	2x6
Bottom Plate	2x6	V	1		10'-2"					Blocking	2x6
Bottom Plate	2x6	W	1		13'-4"					Blocking	2x6
Bottom Plate	2x6	X	1		12'-0"					Blocking	2x6
Top Plate	2x6	Y	1		8'-0"					Blocking	2x6
VTP	2x6	Z	1		10'-8"						
VTP	2x6	AA	1		6'-2"						
Top Plate	2x6	AB	1		12'-10"						
Sill	2x6	E	4		4'-0"						
Sill Cripple	2x6	C	8		2'-1 7/8"						
Hdr Cripple	2x6	B	9		1'-10 1/2"						
Stud	2x6	A	8		9'-1 1/8"						
King	2x6	M	10		9'-1 1/8"						
Sill Cripple Filler	1 1/2"x5 1/2"	D	10		2'-1 7/8"						
Jack Filler	1 1/2"x5 1/2"	F	16		6'-3 3/8"						
2-2x12 - Insulation Core	5 1/2"x11 1/4"	G	4		4'-6"						

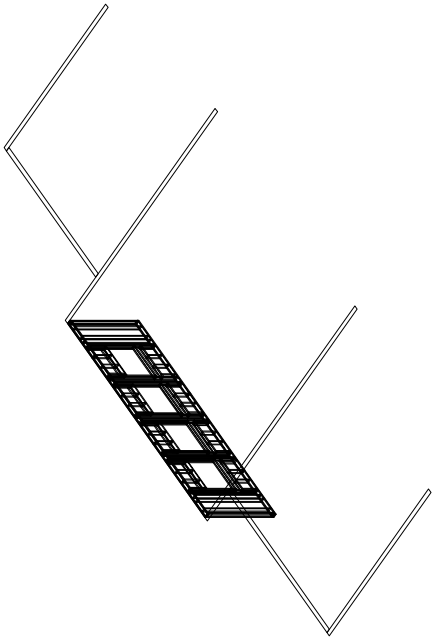

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED


ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED 1X8


ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL

	Project #:	7014-000	Date:	December 12, 2017	Wall #:	BB-CU-10-28-V1
	Project Name:	MEYER	Drawn By:	CRB		
	Project Style:		Checked By:	MANG.		

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

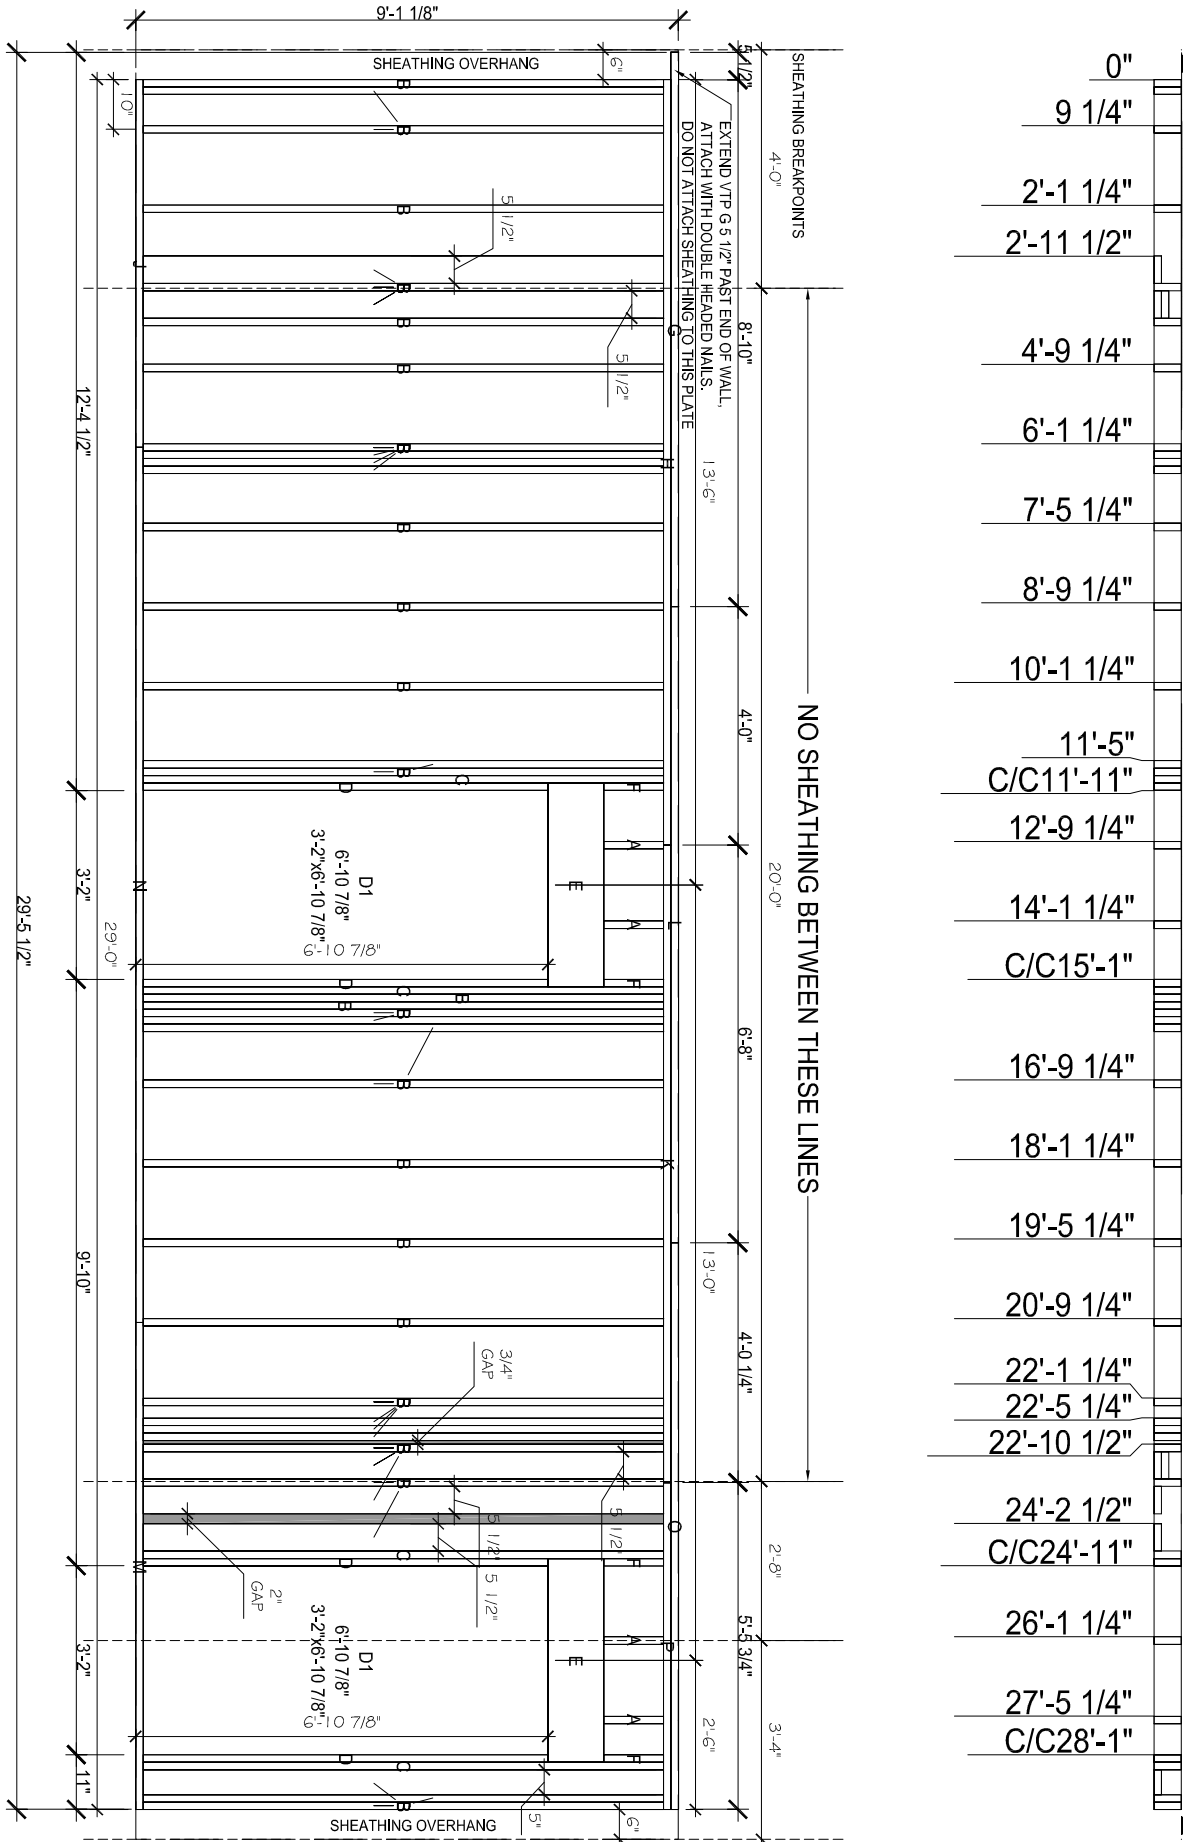

Material (Length is to longest points)					
Timber	Size	Lab.	Qty	No	Length
VTP	2x6	G	1		9'-3 1/2"
Top Plate	2x6	H	1		12'-10"
Bottom Plate	2x6	J	1		6'-2"
Top Plate	2x6	K	1		10'-8 1/4"
VTP	2x6	L	1		10'-8"
Bottom Plate	2x6	M	1		8'-2"
Bottom Plate	2x6	N	1		14'-8"
VTP	2x6	O	1		9'-6"
Top Plate	2x6	P	1		5'-5 3/4"
Hdr Cripple	2x6	A	4		1'-0"
Stud	2x6	B	41		8'-8 5/8"
King Filler	1 1/2"x5 1/2"	C	4		8'-8 5/8"
Jack Filler	1 1/2"x5 1/2"	D	4		6'-9 3/8"
2-2x12 - Insulation Core	5 1/2"x11 1/4"	E	2		3'-5"
Hdr Cripple Filler	1 1/2"x5 1/2"	F	4		1'-0"

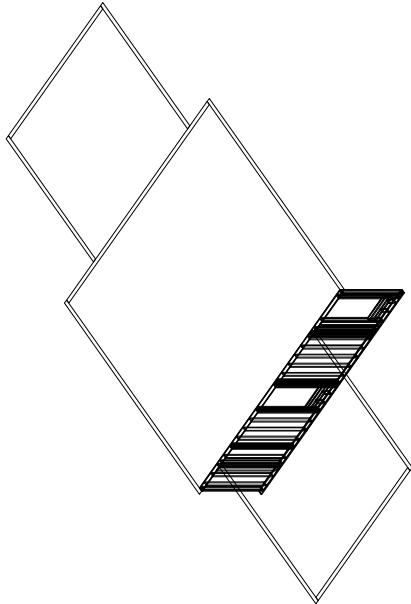

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULT MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED 1/8"

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL



Whisper Creek
By Rocky Mountain Homes


Project #:	7014-000	Date:	December 12, 2017
Project Name:	MEYER	Drawn By:	CRB
Project Style:		Checked By:	MANG.

Wall Location:

Wall #:

C-CS-09-30-V1

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

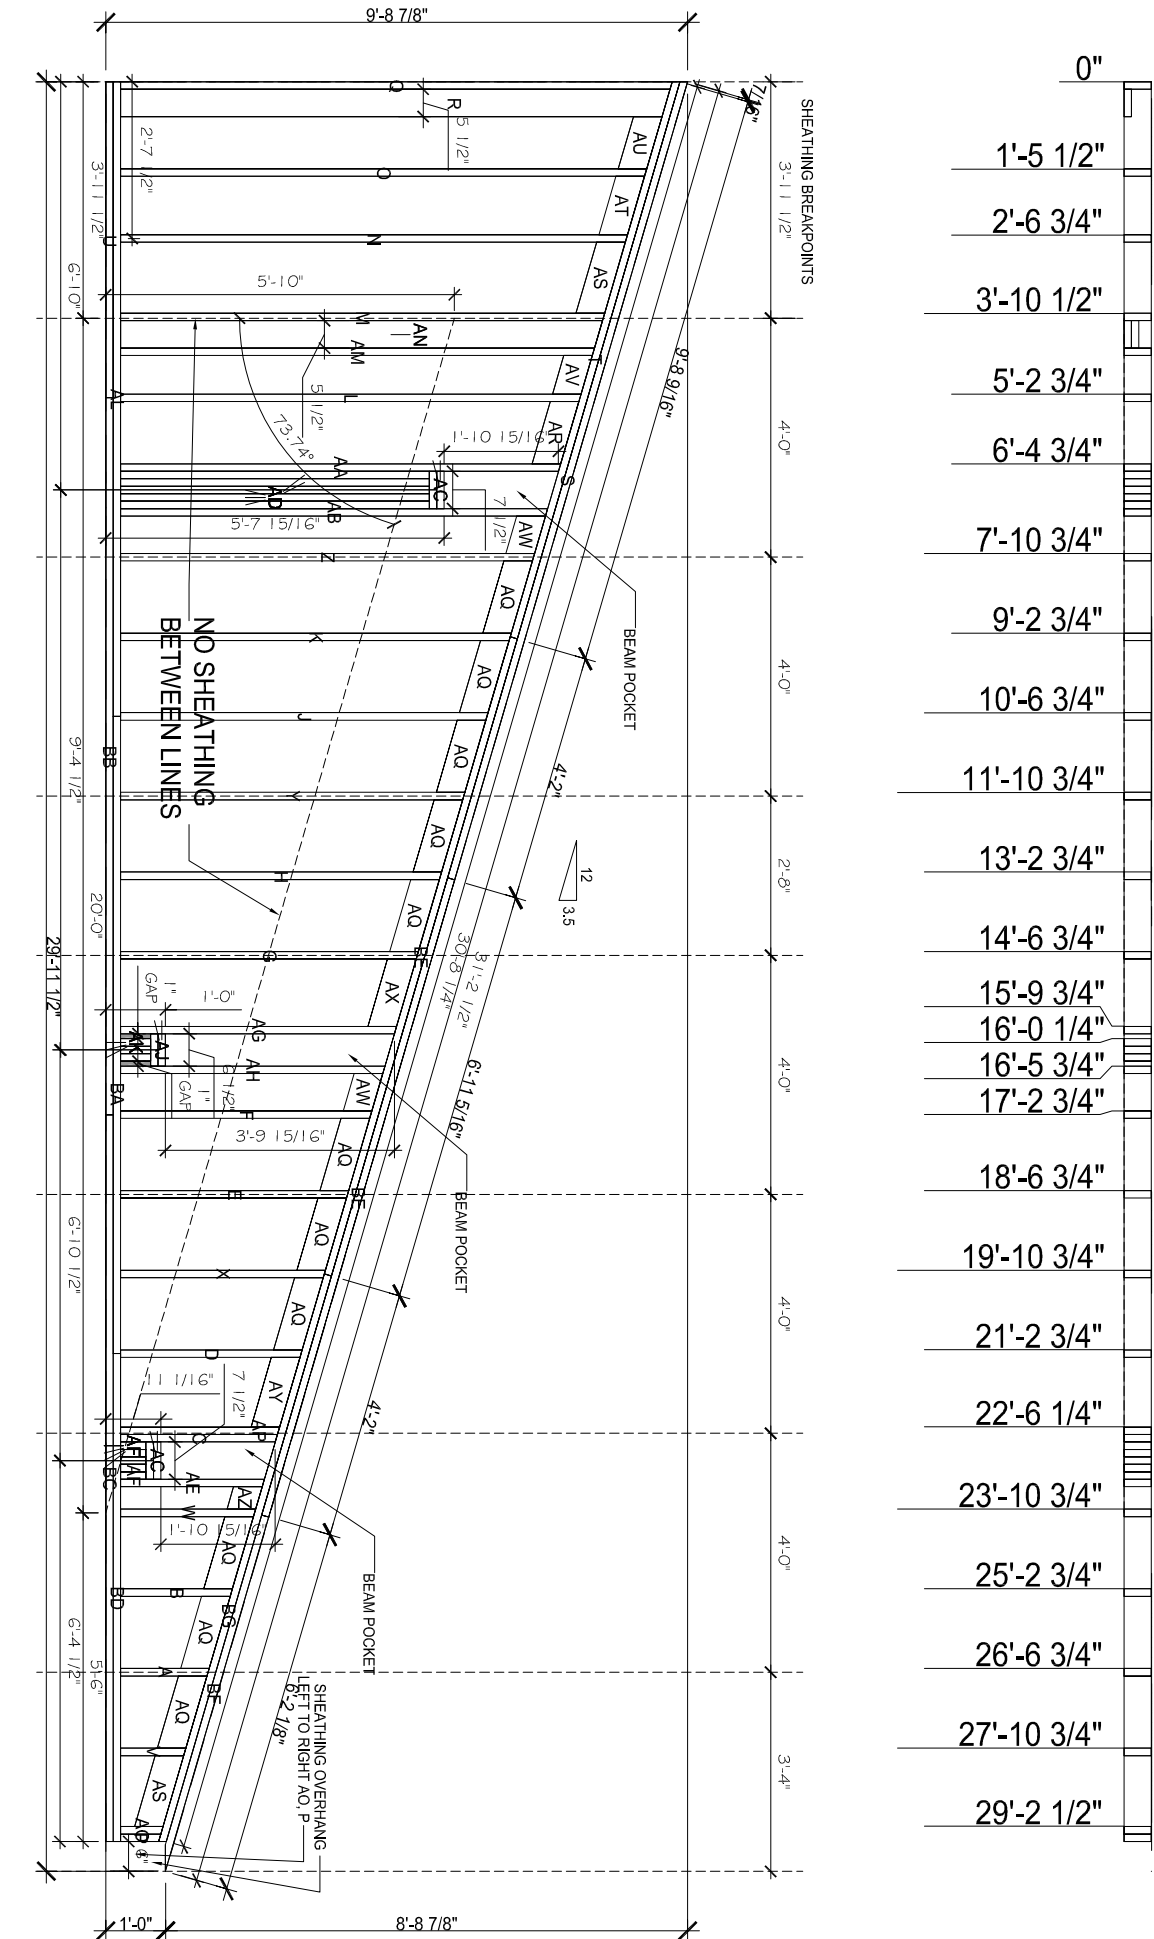

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED 1X8

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL

Material (Length is to longest points)

Material (Length is to longest points)

Material (Length is to longest points)

Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2	Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2	Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2
VTP	2x6	S	1		13'-11"	16.26	16.26			Stud	2x6	J	1		6'-1 3/4"			-16.26	-16.26	Stud	2x6	AO	1		8 1/2"			-16.26	-16.26
VTP	2x6	T	1		9'-8 9/16"	16.26				Stud	2x6	K	1		6'-6 7/16"			-16.26	-16.26	Stud	2x6	AP	1		2'-7 15/16"			-16.26	-16.26
Bottom Plate	2x6	U	1		5'-3 1/2"					Stud	2x6	L	1		7'-8 7/16"			-16.26	-16.26	King	2x6	AA	1		7'-4 3/8"			-16.26	-16.26
Bottom Plate	2x6	AL	1		10'-7 1/2"					Stud	2x6	M	1		8'-1 3/16"			-16.26	-16.26	King	2x6	AB	1		7'-1 3/4"			-16.26	-16.26
Bottom Plate	2x6	BA	1		10'-8"					Stud	2x6	N	1		8'-5 3/4"			-16.26	-16.26	King	2x6	AE	1		2'-4 7/8"			-16.26	-16.26
Bottom Plate	2x6	BB	1		12'-0"					Stud	2x6	O	1		8'-9 5/8"			-16.26	-16.26	King	2x6	AG	1		4'-7 3/8"			-16.26	-16.26
Bottom Plate	2x6	BC	1		12'-2"					Stud	2x6	P	1		8 1/16"			-16.26	-16.26	King	2x6	AH	1		4'-5 1/16"			-16.26	-16.26
Bottom Plate	2x6	BD	1		8'-2"					Stud	2x6	Q	1		9'-2 3/4"			-16.26	-16.26	Unknown	2x6	AC	4		7 1/2"				
VTP	2x6	BE	2		11'-1 5/16"					Stud	2x6	R	1		9'-2 5/16"			-16.26	-16.26	Unknown	2x6	AJ	2		6 1/2"				
VTP	2x6	BF	1		6'-2 1/8"					Stud	2x6	V	1		1'-1 1/8"			-16.26	-16.26	Blocking	2x6	AQ	11		1'-4 11/16"			16.26	16.26
VTP	2x6	BG	1		9'-10 3/4"					Stud	2x6	W	1		2'-3 1/8"			-16.26	-16.26	Blocking	2x6	AR	1		1'-2 5/8"			16.26	16.26
VTP	2x6	A	1		1'-5 3/4"					Stud	2x6	X	1		3'-5 1/8"			-16.26	-16.26	Blocking	2x6	AS	2		1'-4 7/16"			16.26	16.26
Stud	2x6	B	1		1'-10 7/16"					Stud	2x6	Y	1		5'-9 1/8"			-16.26	-16.26	Blocking	2x6	AT	1		1'-1 13/16"			16.26	16.26
Stud	2x6	C	1		2'-7 1/2"					Stud	2x6	Z	1		6'-11 1/8"			-16.26	-16.26	Blocking	2x6	AU	1		1'-0 9/16"			16.26	16.26
Stud	2x6	D	1		3'-0 7/16"					Stud	2x6	AD	5		5'-1 15/16"			-16.26	-16.26	Blocking	2x6	AV	1		9 11/16"			16.26	16.26
Stud	2x6	E	1		3'-9 3/4"					Stud	2x6	AF	5		5 1/16"					Blocking	2x6	AW	2		9 7/16"			16.26	16.26
Stud	2x6	F	1		4'-2 7/16"					Stud	2x6	AK	3		6"					Blocking	2x6	AX	1		1'-3 11/16"			16.26	16.26
Stud	2x6	G	1		4'-11 3/4"					Stud	2x6	AM	1		7'-11 1/8"			-16.26	-16.26	Blocking	2x6	AY	1		1'-4 3/16"			16.26	16.26
Stud	2x6	H	1		5'-4 7/16"					Stud	2x6	AN	2		8'-0 3/4"			-16.26	-16.26	Blocking	2x6	AZ	1		6 5/16"			16.26	16.26



Whisper Creek
By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Checked By:


MANG.

Wall Location:


Wall #:

CC-CU-09-30-V1

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

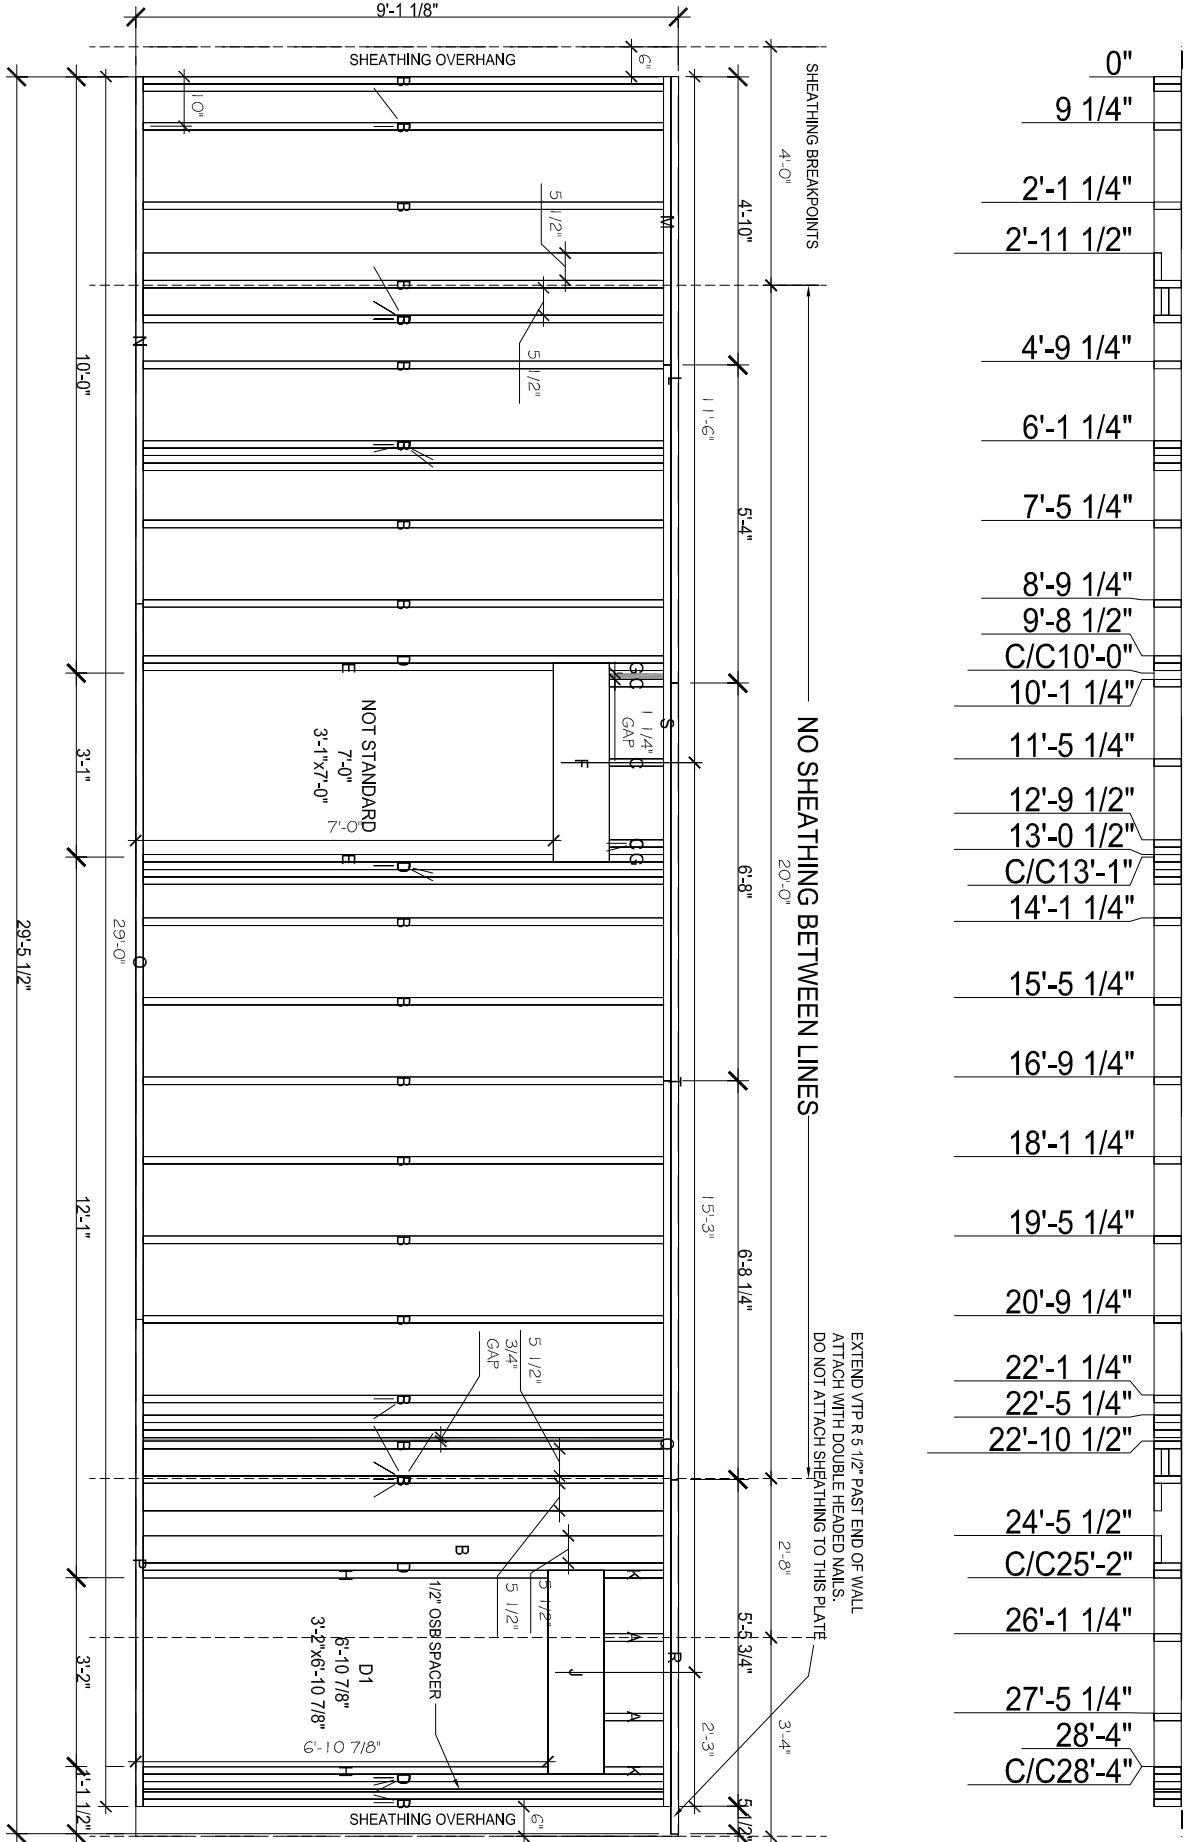

Material (Length is to longest points)					
Timber	Size	Lab.	Qty	No	Length
VTP	2x6	L	1		10'-2"
Top Plate	2x6	M	1		4'-10"
Bottom Plate	2x6	N	1		8'-10"
Bottom Plate	2x6	O	1		12'-0"
Bottom Plate	2x6	P	1		8'-2"
Top Plate	2x6	Q	1		12'-2"
VTP	2x6	R	1		5'-11 1/4"
Top Plate	2x6	S	1		12'-0"
VTP	2x6	T	1		13'-4 1/4"
Hdr Cripple	2x6	A	2		1'-0"
Hdr Cripple	2x6	C	4		10 7/8"
Stud	2x6	B	34		8'-8 5/8"
King Filler	1 1/2"x5 1/2"	D	8		8'-8 5/8"
Jack Filler	1 1/2"x5 1/2"	E	2		6'-10 1/2"
2-2x12 - Insulation Core	5 1/2"x11 1/4"	F	1		3'-4"
Hdr Cripple Filler	1 1/2"x5 1/2"	G	2		10 7/8"
Jack Filler	1 1/2"x5 1/2"	H	2		6'-9 3/8"
2-2x12 - Insulation Core	5 1/2"x11 1/4"	J	1		3'-5"
Hdr Cripple Filler	1 1/2"x5 1/2"	K	2		1'-0"

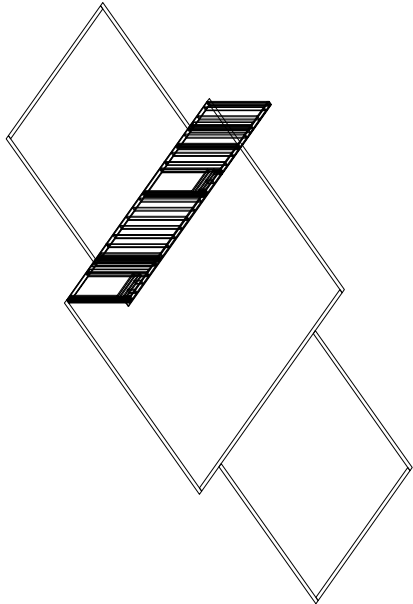

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL



Whisper Creek
By Rocky Mountain Homes



Project #:	7014-000	Date:	December 12, 2017
Project Name:	MEYER	Drawn By:	CRB
Project Style:		Checked By:	MANG.

Wall Location:

Wall #:

D-CS-09-30-V2

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

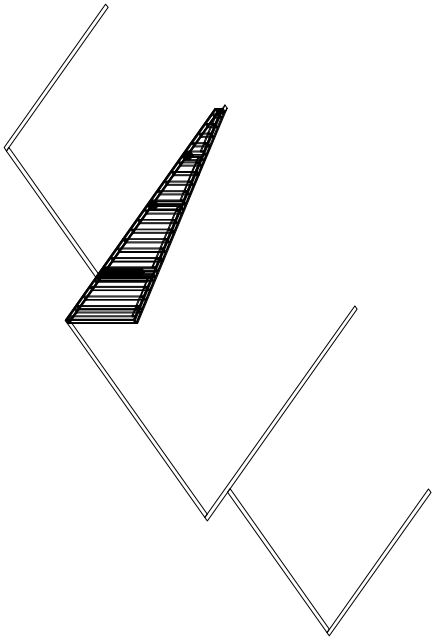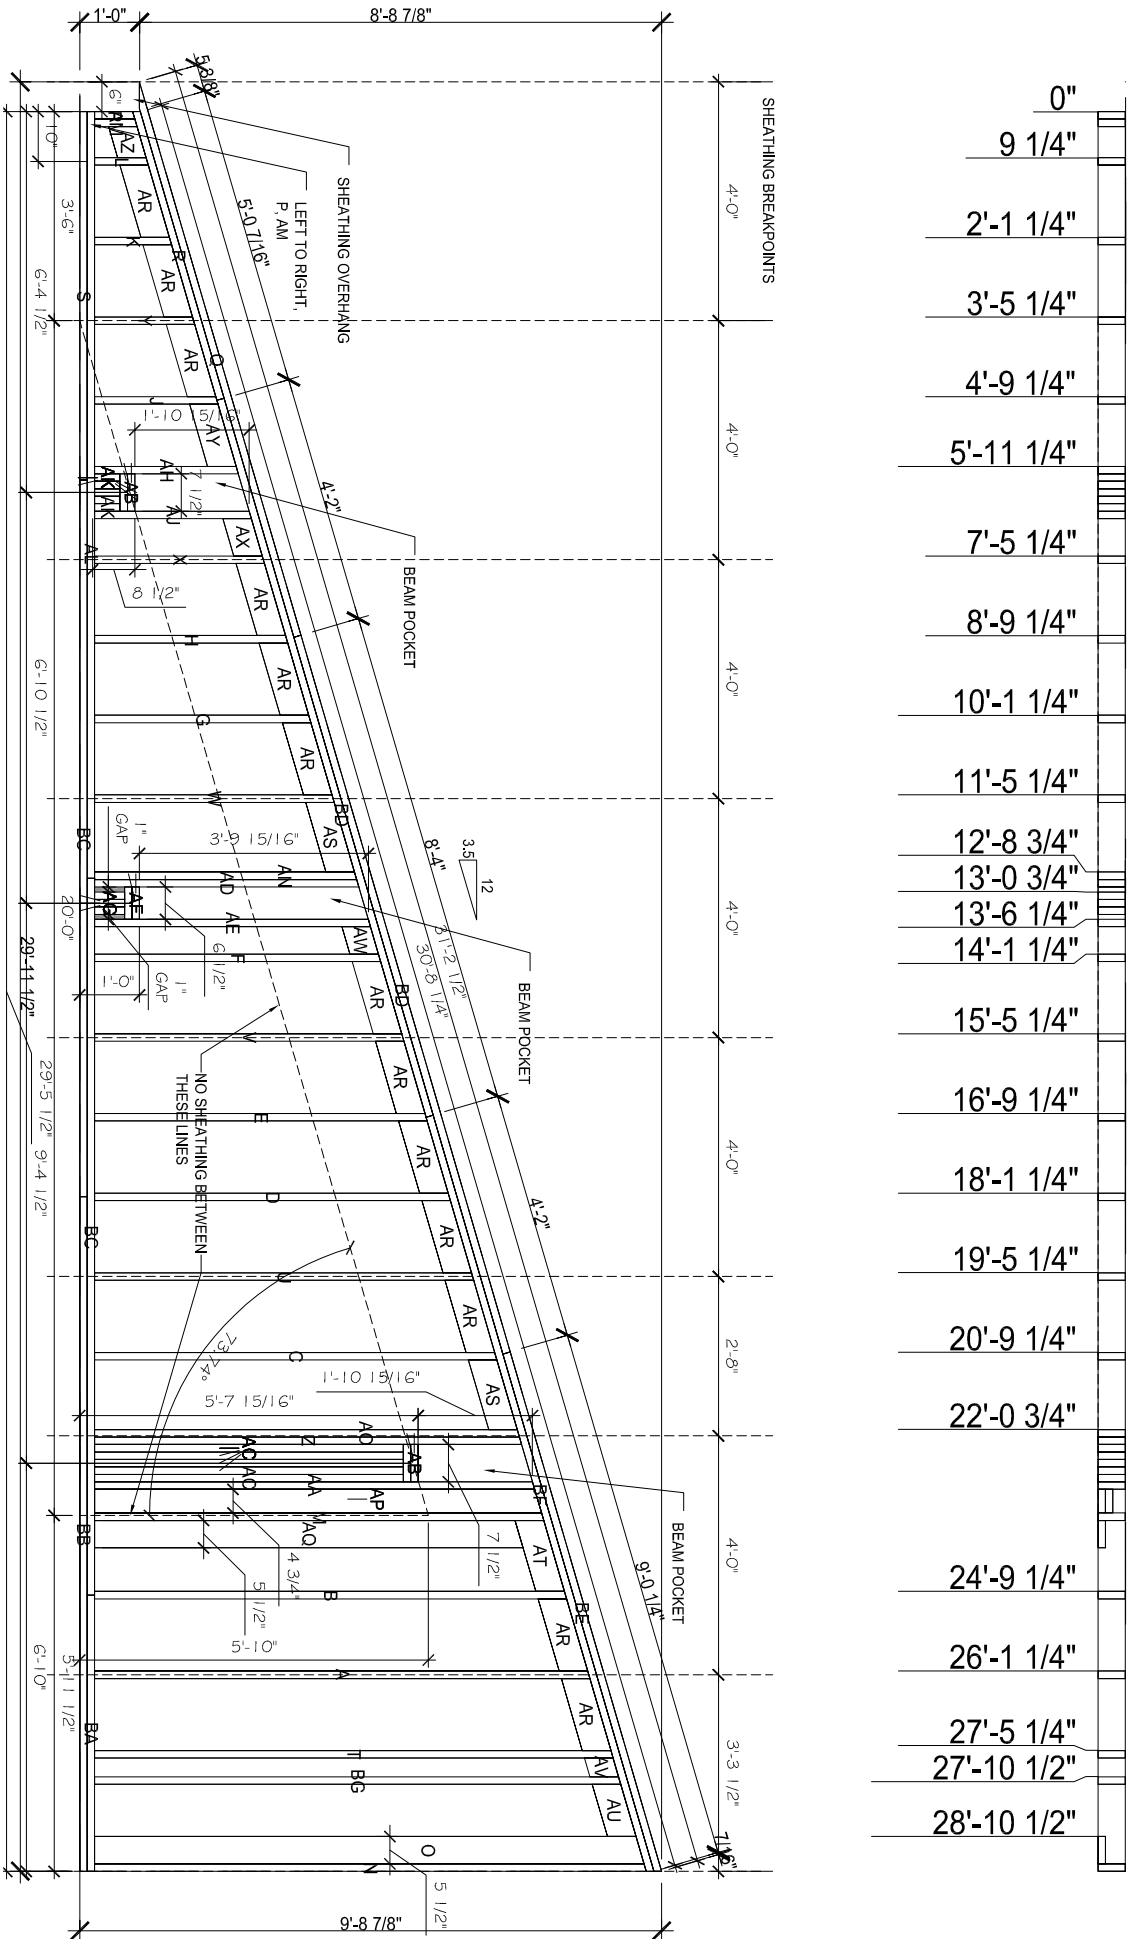

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 1626 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.

EACH SIDE, EACH LAYER

-STAGGERED 1X8

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL

Material (Length is to longest points)

Material (Length is to longest points)

Material (Length is to longest points)

Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2	Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2	Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2
Top Plate	2x6	Q	1		9'-7 13/16"	73.74	73.74			Stud	2x6	K	1		1'-3 7/16"			16.26	16.26	King	2x6	Z	1		7'-1 3/4"			16.26	16.26
Top Plate	2x6	R	1		5'-0 7/16"	-16.26	-16.26			Stud	2x6	L	1		10 3/4"			16.26	16.26	King	2x6	AA	1		7'-4 3/8"			16.26	16.26
Bottom Plate	2x6	S	1		6'-2"					Stud	2x6	M	1		7'-6 3/16"			16.26	16.26	King	2x6	AD	1		4'-5 1/16"			16.26	16.26
Bottom Plate	2x6	AL	1		12'-10"					Stud	2x6	N	1		9'-2 3/4"			16.26	16.26	King	2x6	AE	1		4'-7 3/8"			16.26	16.26
Bottom Plate	2x6	BA	1		4'-7 1/2"					Stud	2x6	O	1		9'-2 5/16"			16.26	16.26	King	2x6	AH	1		2'-4 7/8"			16.26	16.26
Bottom Plate	2x6	BB	1		11'-3 1/2"					Stud	2x6	P	1		8 1/16"			16.26	16.26	King	2x6	AJ	1		2'-7 1/2"			16.26	16.26
Bottom Plate	2x6	BC	2		12'-0"					Stud	2x6	T	1		8'-8 1/8"			16.26	16.26	King	2x6	AN	1		4'-4 5/8"			16.26	16.26
Top Plate	2x6	BD	2		12'-6"					Stud	2x6	U	1		6'-4 1/8"			16.26	16.26	King	2x6	AO	1		7'-1 5/16"			16.26	16.26
Top Plate	2x6	BE	1		9'-0 11/16"					Stud	2x6	V	1		5'-2 1/8"			16.26	16.26	Unknown	2x6	AB	4		7 1/2"				
Top Plate	2x6	BF	1		13'-2 1/4"					Stud	2x6	W	1		4'-0 1/8"			16.26	16.26	Unknown	2x6	AF	2		6 1/2"				
Stud	2x6	A	1		8'-3 7/16"					Stud	2x6	X	1		2'-10 1/8"			16.26	16.26	King	2x6	AR	13		1'-4 11/16"			-16.26	-16.26
Stud	2x6	B	1		7'-10 3/4"					Stud	2x6	Y	1		1'-8 1/8"			16.26	16.26	King	2x6	AS	2		1'-4 3/16"			-16.26	-16.26
Stud	2x6	C	1		6'-8 3/4"					Stud	2x6	AC	5		5'-1 15/16"			16.26	16.26	King	2x6	AT	1		1'-4 7/16"			-16.26	-16.26
Stud	2x6	D	1		5'-11 7/16"					Stud	2x6	AG	3		6"			16.26	16.26	King	2x6	AU	1		1'-0 9/16"			-16.26	-16.26
Stud	2x6	E	1		5'-6 3/4"					Stud	2x6	AK	5		5 1/16"			16.26	16.26	King	2x6	AV	1		5 1/2"			-16.26	-16.26
Stud	2x6	F	1		4'-9 7/16"					Stud	2x6	AM	1		8 1/2"			16.26	16.26	King	2x6	AW	1		7 5/16"			-16.26	-16.26
Stud	2x6	G	1		3'-7 7/16"					Stud	2x6	AP	2		7'-5 3/4"			16.26	16.26	King	2x6	AX	1		9 7/16"			-16.26	-16.26
Stud	2x6	H	1		3'-2 3/4"					Stud	2x6	AQ	1		7'-2 1/16"			16.26	16.26	King	2x6	AY	1		1'-2 5/8"			-16.26	-16.26
Stud	2x6	J	1		2'-0 3/4"					Stud	2x6	BG	1		8'-9 5/8"			16.26	16.26	King	2x6	AZ	1		8 1/8"			-16.26	-16.26



Whisper Creek

By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Wall Location:



Checked By:

MANG.

Wall #:

DD-CU-09-30-V2

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

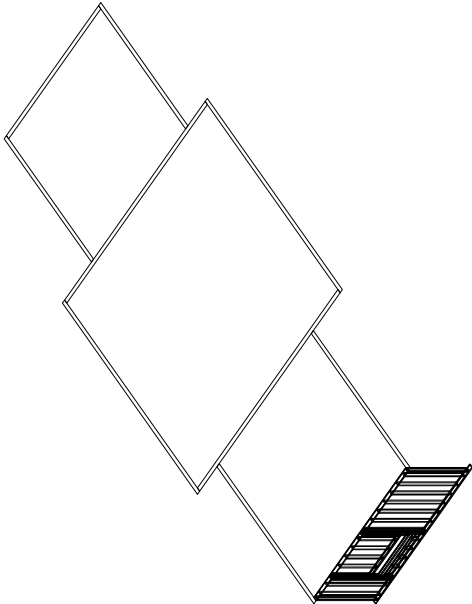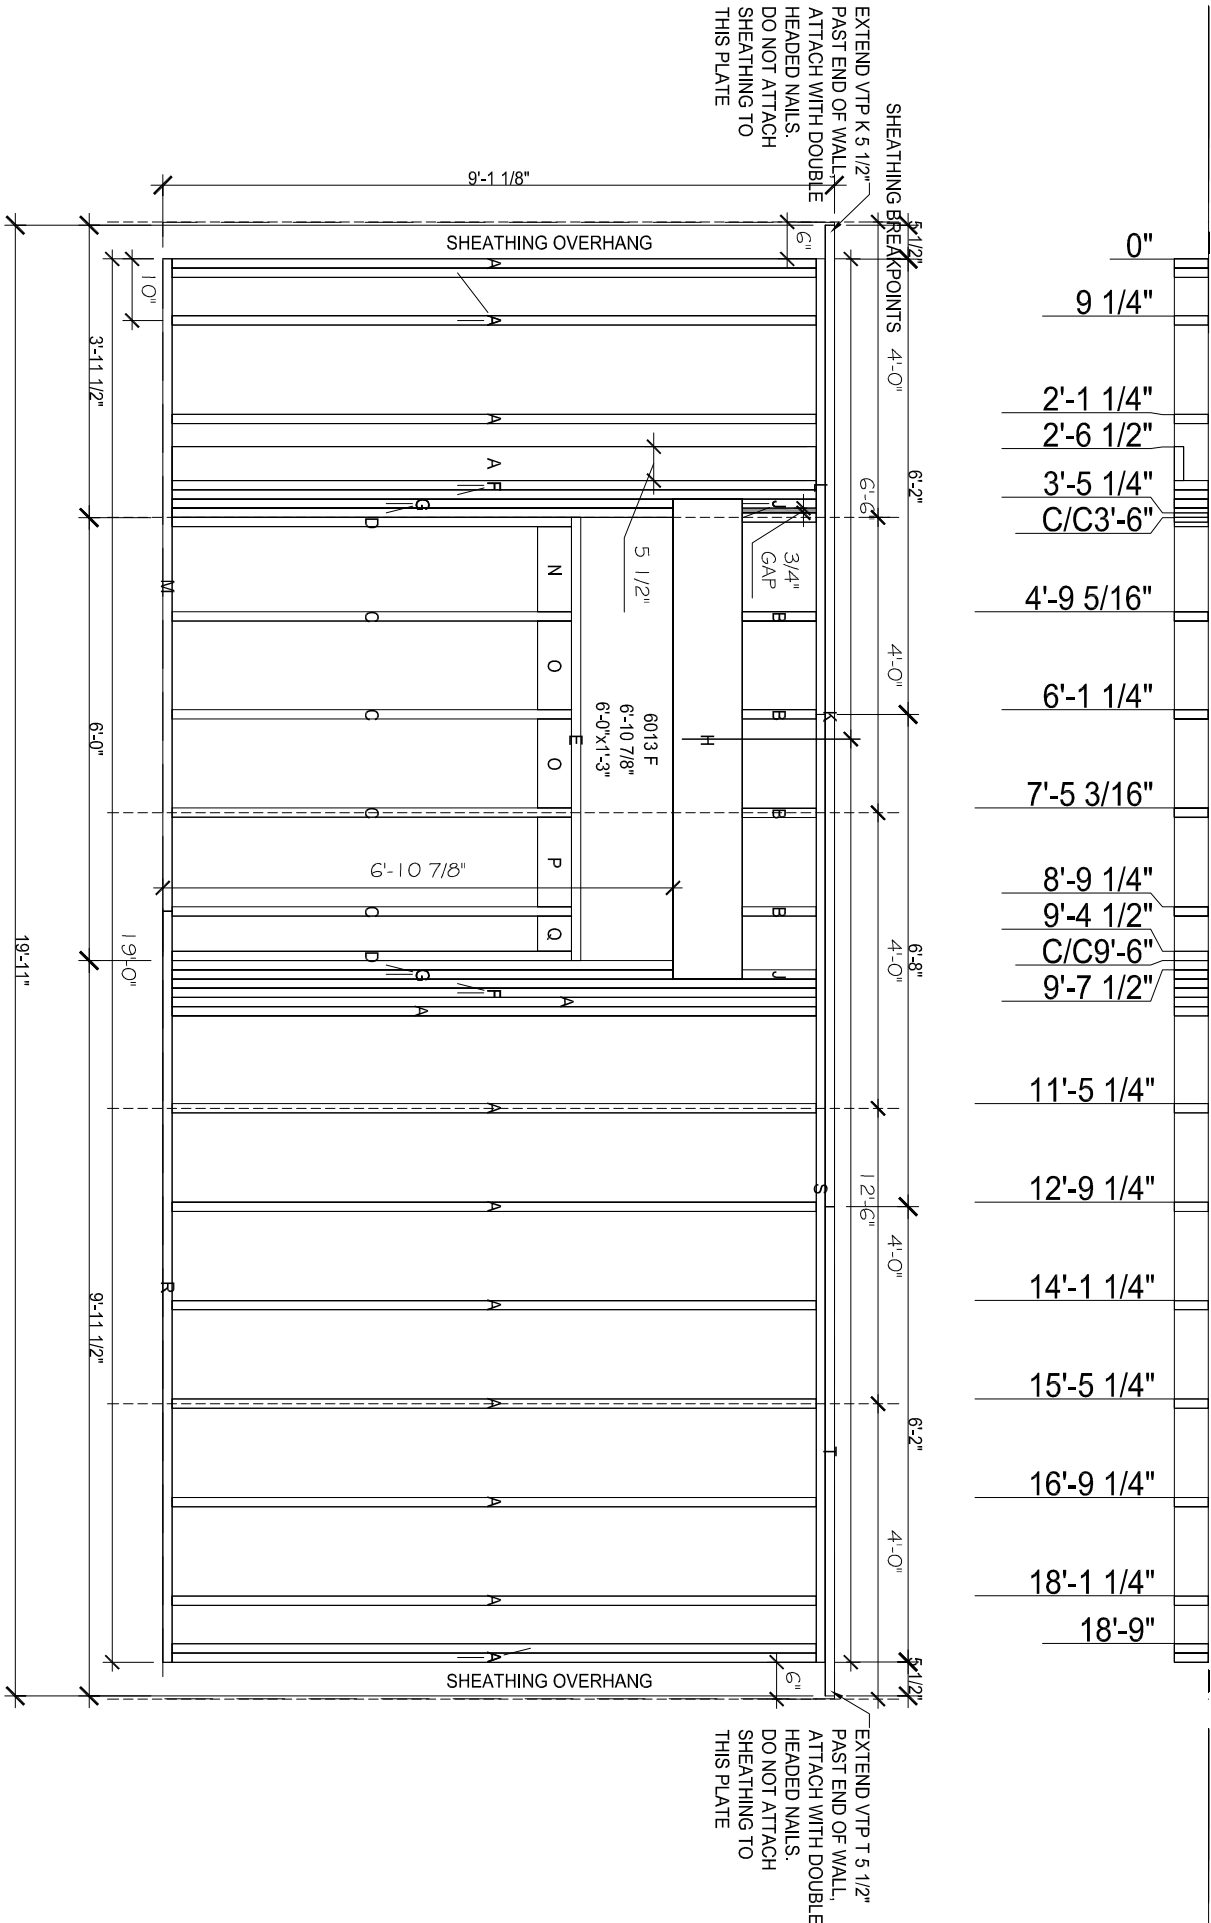

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL

Material (Length is to longest points)

Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2
VTP	2x6	K	1		13'-3 1/2"				
Top Plate	2x6	L	1		6'-2"				
Bottom Plate	2x6	M	1		8'-10"				
Bottom Plate	2x6	R	1		10'-2"				
Top Plate	2x6	S	1		12'-10"				
VTP	2x6	T	1		6'-7 1/2"				
Sill	2x6	E	1		6'-0"				
Sill Cripple	2x6	C	4		5'-4 7/8"				
Hdr Cripple	2x6	B	4		1'-0"				
Stud	2x6	A	15		8'-8 5/8"				
Sill Cripple Filler	1 1/2"x5 1/2"	D	2		5'-4 7/8"				
King Filler	1 1/2"x5 1/2"	F	4		8'-8 5/8"				
Jack Filler	1 1/2"x5 1/2"	G	4		6'-9 3/8"				
2-2x12 - Insulation Core	5 1/2"x11 1/4"	H	1		6'-6"				
Hdr Cripple Filler	1 1/2"x5 1/2"	J	3		1'-0"				
Blocking	2x6	N	1		1'-1 13/16"				
Blocking	2x6	O	2		1'-2 7/16"				
Blocking	2x6	P	1		1'-2 9/16"				
Blocking	2x6	Q	1		5 3/4"				



Whisper Creek

By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Checked By:


MANG.

Wall Location:

Wall #:

E-CS-09-20-V1

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

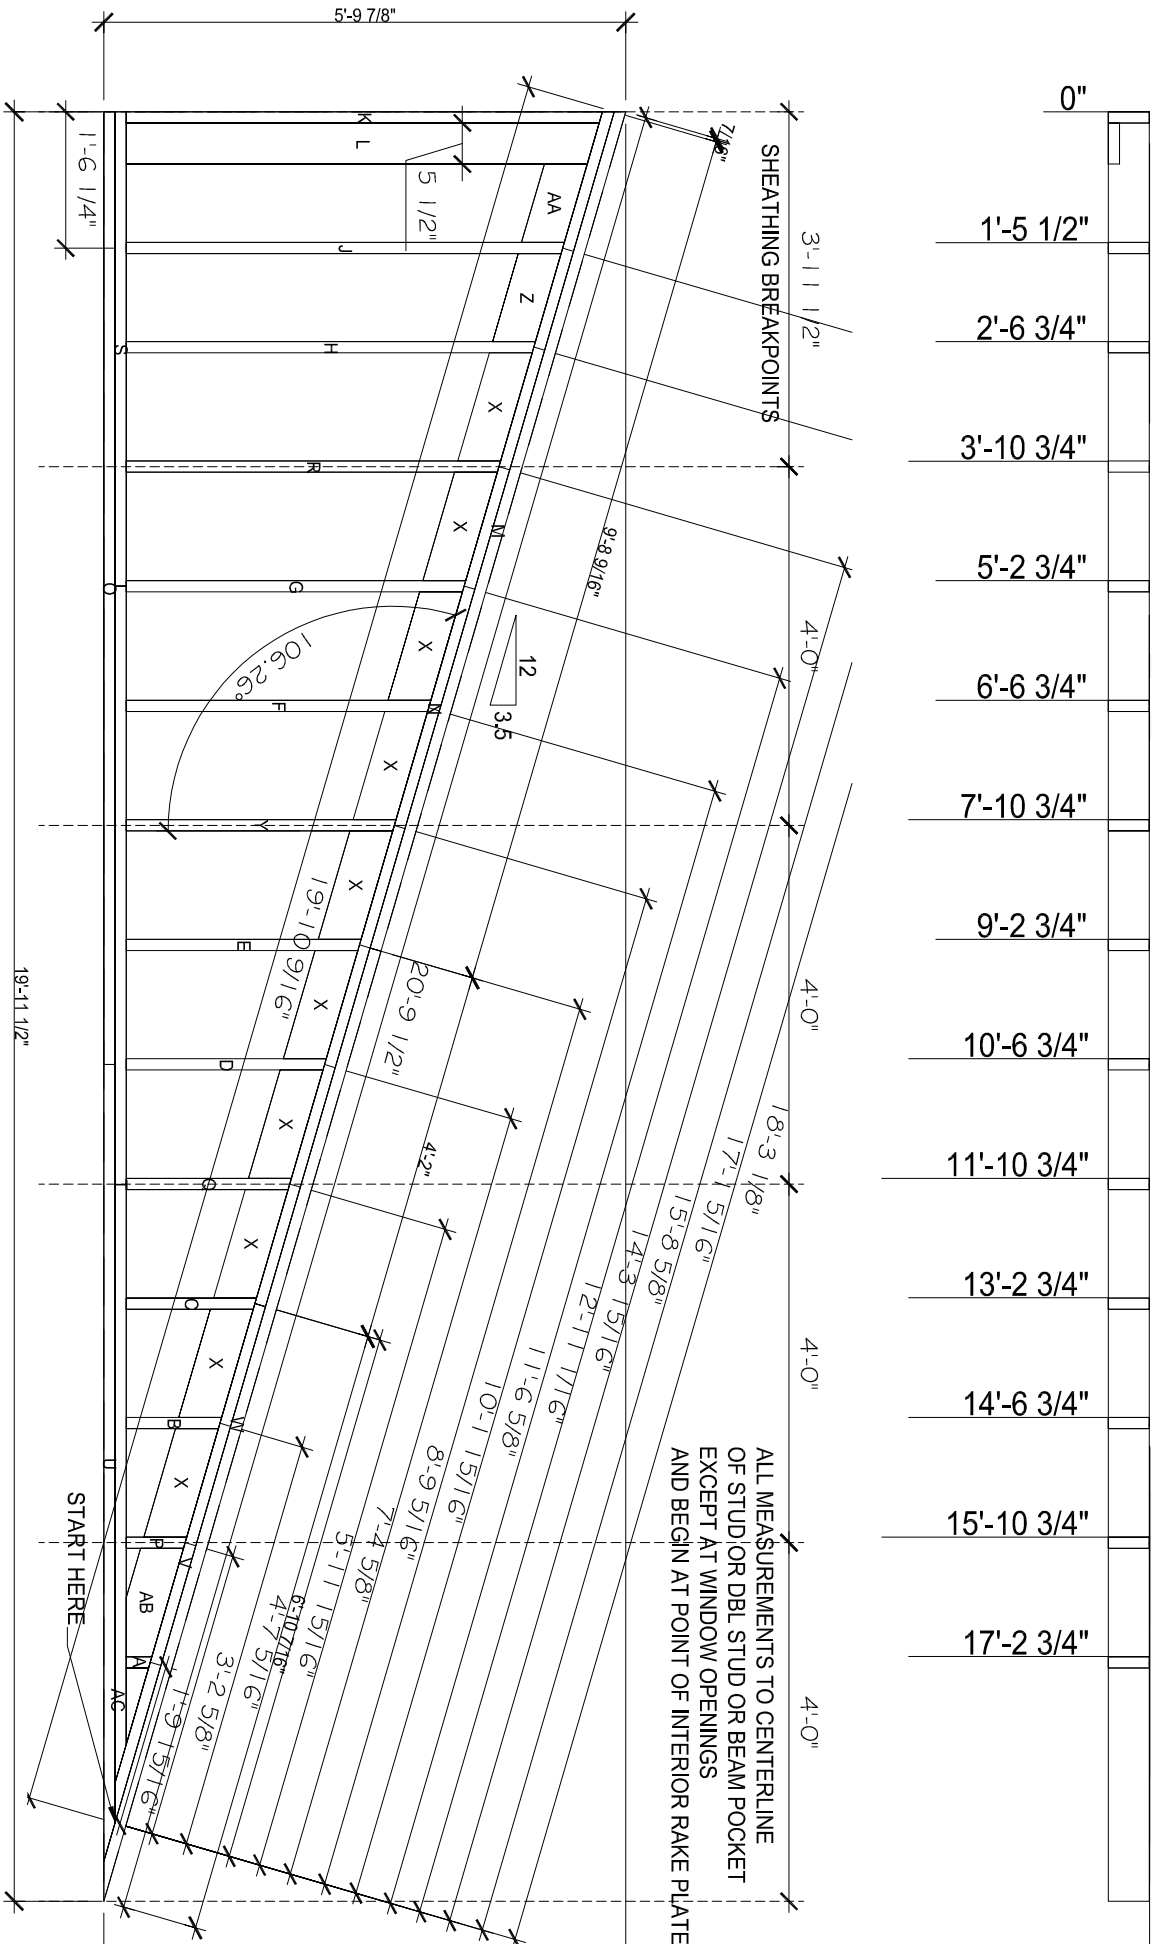

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTIMEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.

EACH SIDE, EACH LAYER

-STAGGERED T&B

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL

Material (Length is to longest points)

Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev. 2
VTP	2x6	M	1		9'-9"	16.26	16.26		
VTP	2x6	N	1		13'-10 9/16"	16.26	16.26		
Bottom Plate	2x6	O	1		10'-7 1/2"				
Bottom Plate	2x6	S	1		5'-3 1/2"				
Bottom Plate	2x6	T	1		13'-4 1/8"				
Bottom Plate	2x6	U	1		8'-10 5/8"				
VTP	2x6	V	1		5'-11 15/16"				
VTP	2x6	W	1		11'-0 7/16"				
Stud	2x6	A	1		3 7/16"				
Stud	2x6	B	1		1'-0 3/4"				
Stud	2x6	C	1		1'-5 7/16"				
Stud	2x6	D	1		2'-2 3/4"				
Stud	2x6	E	1		2'-7 7/16"				
Stud	2x6	F	1		3'-4 3/4"				
Stud	2x6	G	1		3'-9 7/16"				
Stud	2x6	H	1		4'-6 3/4"				
Stud	2x6	J	1		4'-10 5/8"				
Stud	2x6	K	1		5'-3 3/4"				
Stud	2x6	L	1		5'-3 5/16"				

Material (Length is to longest points)

Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev. 2
Stud	2x6	P	1		8 1/8"			-16.26	-16.26
Stud	2x6	Q	1		1'-10 1/8"			-16.26	-16.26
Stud	2x6	R	1		4'-2 1/8"			-16.26	-16.26
Stud	2x6	Y	1		3'-0 1/8"			-16.26	-16.26
Blocking	2x6	X	10		1'-4 11/16"			16.26	16.26
Blocking	2x6	Z	1		1'-1 13/16"			16.26	16.26
Blocking	2x6	AA	1		1'-0 9/16"			16.26	16.26
Blocking	2x6	AB	1		1'-4 1/16"			16.26	16.26
Blocking	2x6	AC	1		10 11/16"			-73.74	-73.74



Whisper Creek

By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Checked By:


MANG.

Wall Location:

Wall #:

EE-CU-09-20-V1

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

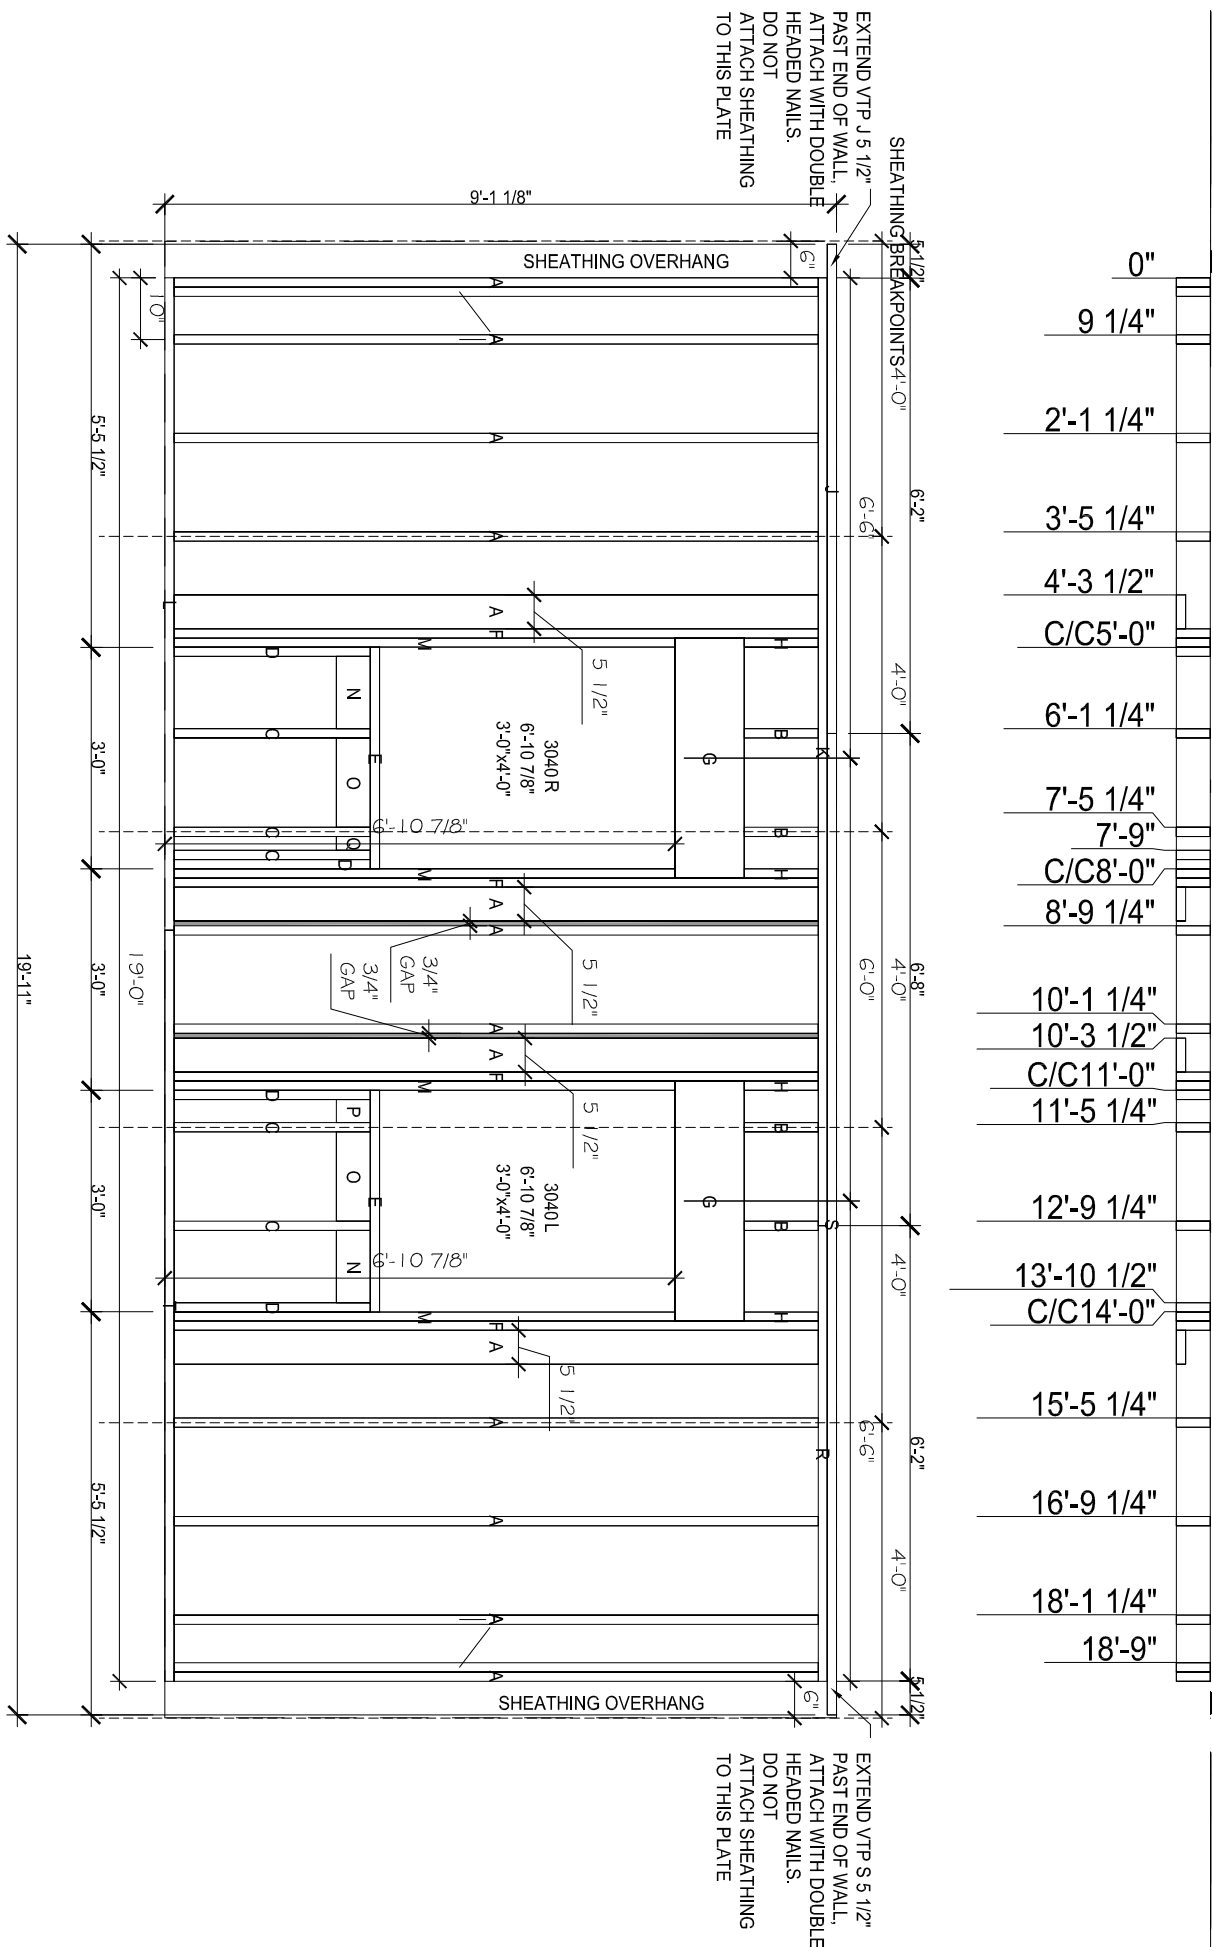

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: A) STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS OTHERWISE NOTED. B) NAILING PATTERN FOR SHEATHING TO BE 3" ON THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED STRUCTURAL SHEATHING U.N.O.


(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER

-STAGGERED T&B


ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING PAPER 6" BELOW BOTTOM OF THE WALL

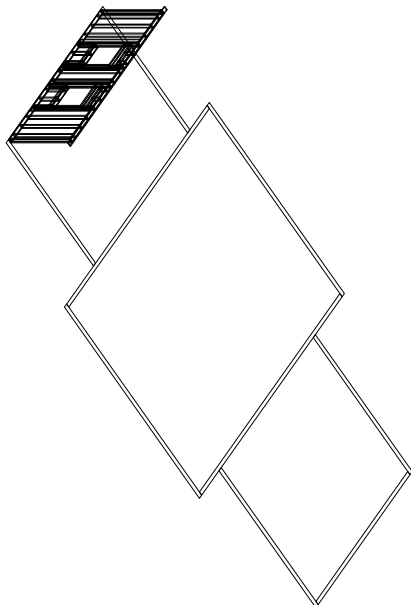

Material (Length is to longest points)									
Timber	Size	Lab.	Qty	No	Length	Cut 1	Rev. 1	Cut 2	Rev.2
VTP	2x6	J	1		6'-7 1/2"				
Top Plate	2x6	K	1		12'-10"				
Bottom Plate	2x6	L	1		8'-10"				
Top Plate	2x6	R	1		6'-2"				
VTP	2x6	S	1		13'-3 1/2"				
Bottom Plate	2x6	T	1		10'-2"				
Sill	2x6	E	2		3'-0"				
Sill Cripple	2x6	C	5		2'-7 7/8"				
Hdr Cripple	2x6	B	4		1'-0"				
Stud	2x6	A	16		8'-8 5/8"				
Sill Cripple Filler	1 1/2"x6 1/2"	D	4		2'-7 7/8"				
King Filler	1 1/2"x6 1/2"	F	4		8'-8 5/8"				
2-2x12 - Insulation Core	5 1/2"x11 1/4"	G	2		3'-3"				
Hdr Cripple Filler	1 1/2"x6 1/2"	H	4		1'-0"				
Jack Filler	1 1/2"x6 1/2"	M	4		6'-9 3/8"				
Blocking	2x6	N	2		11 3/4"				
Blocking	2x6	O	2		1'-2 1/2"				
Blocking	2x6	P	1		3 3/4"				
Blocking	2x6	Q	1		2 1/4"				

	Project #:	7014-000	Date:	December 12, 2017	
	Project Name:	MEYER	Drawn By:	Wall Location:	Wall #:
	Project Style:		CRB		
			Checked By:		F-CS-09-20-V2
			MANG.		

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

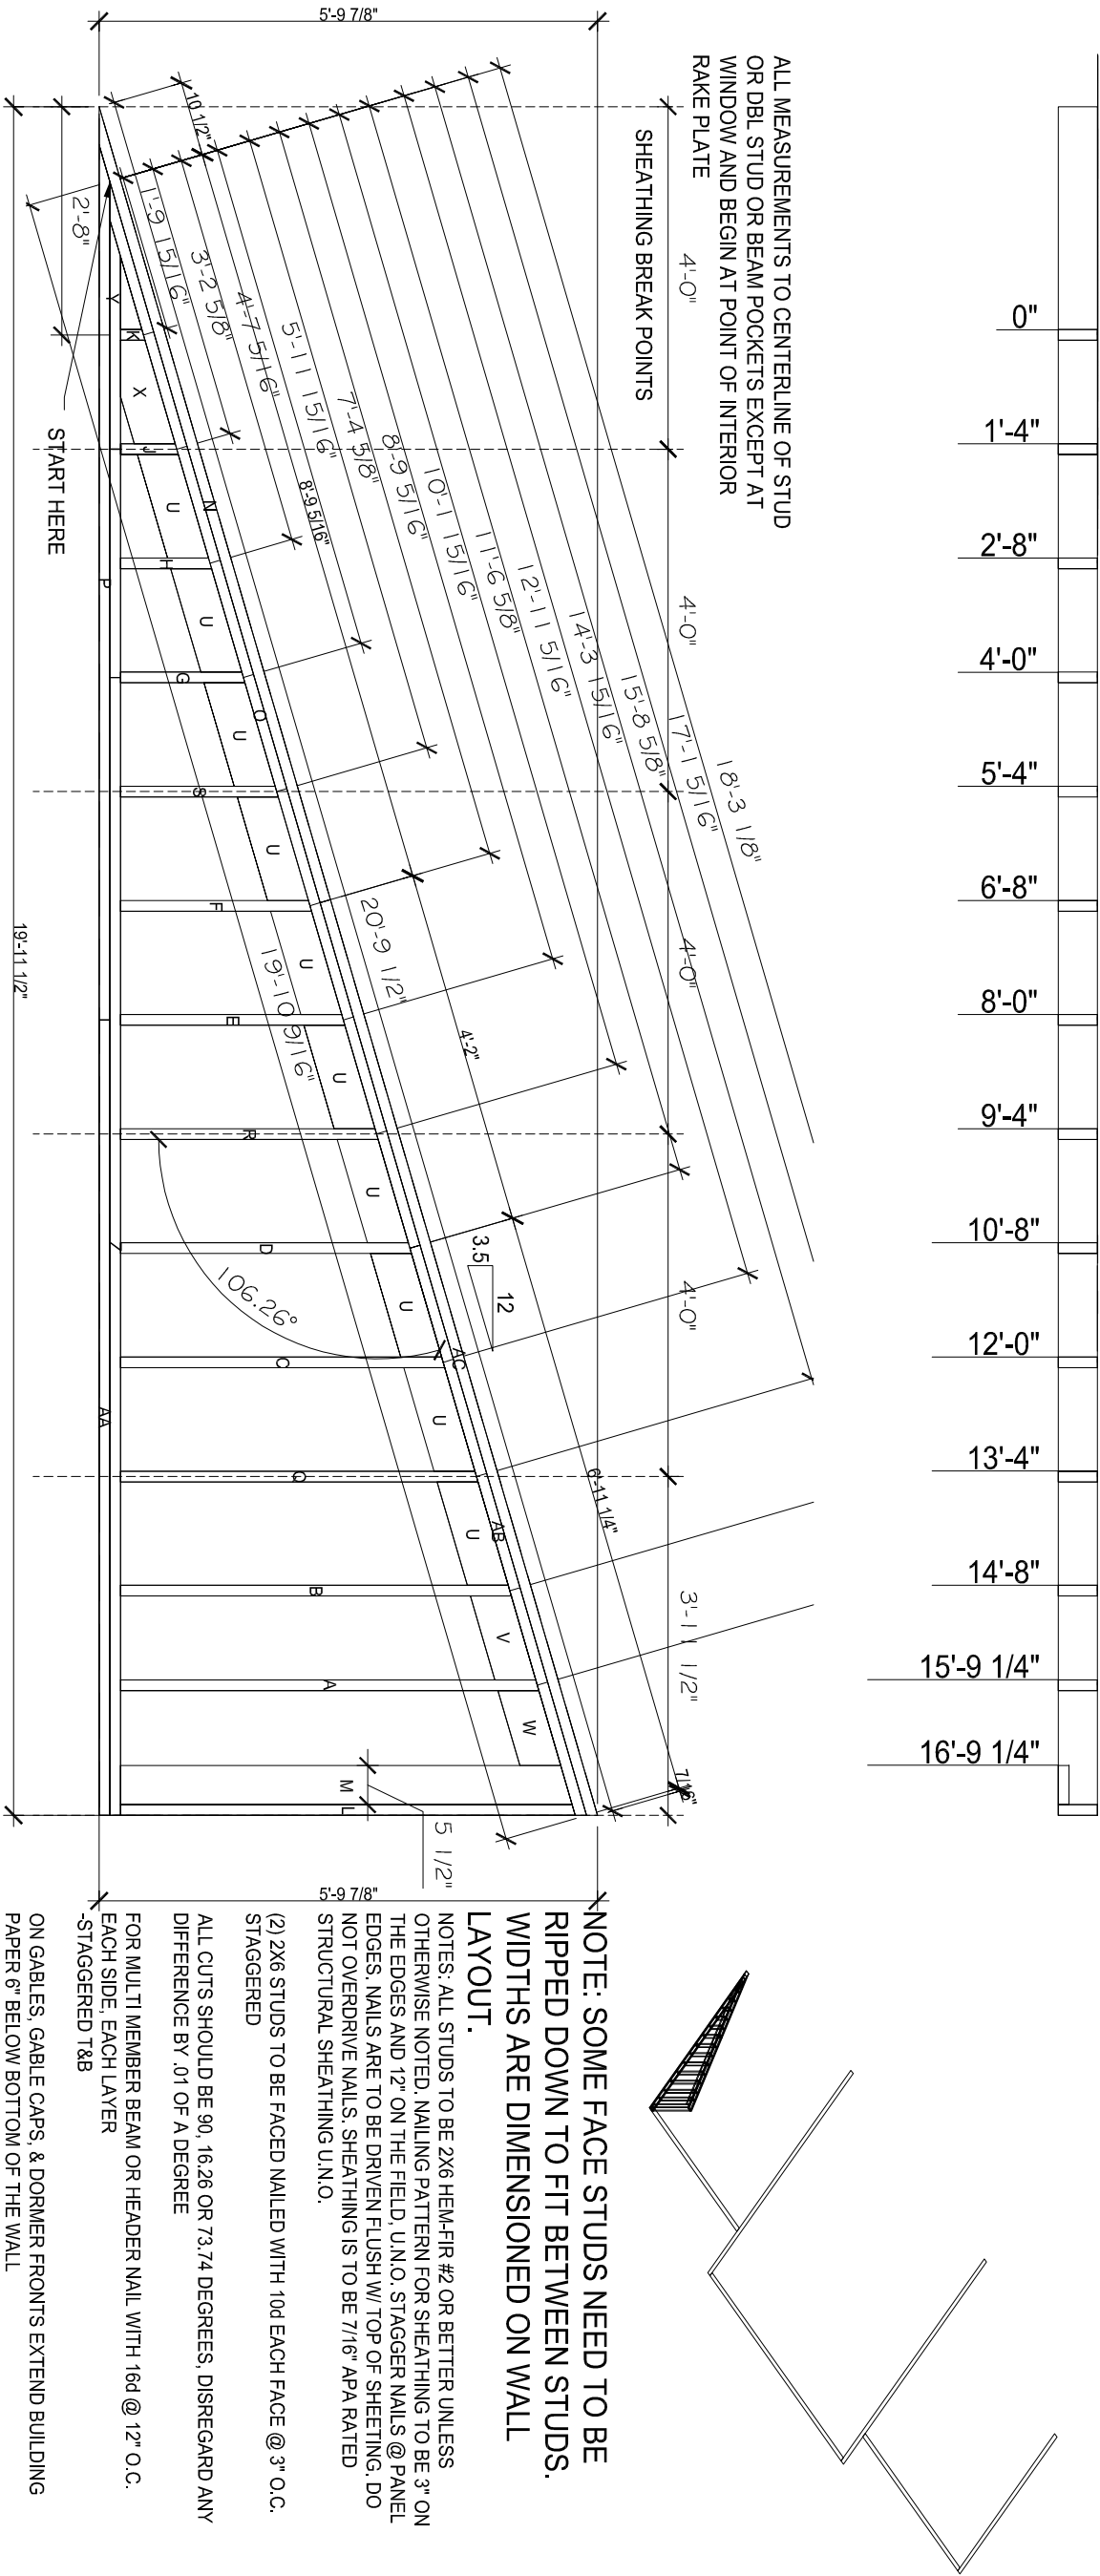

Material (Length is to longest points)										Material (Length is to longest points)									
Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2	Timber	Size	Label	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2
Top Plate	2x6	N	1		9'-7 13/16"	73.74	73.74			Stud	2x6	M	1		5'-3 5/16"			16.26	16.26
Top Plate	2x6	O	1		12'-11 5/16"	73.74	73.74			Stud	2x6	Q	1		4'-2 1/8"			16.26	16.26
Bottom Plate	2x6	P	1		10'-2 5/8"	-73.74	-73.74			Stud	2x6	R	1		3'-0 1/8"			16.26	16.26
Bottom Plate	2x6	T	1		5'-4 1/8"	-73.74	-73.74			Stud	2x6	S	1		1'-10 1/8"			16.26	16.26
Bottom Plate	2x6	Z	1		13'-3 1/2"					Blocking	2x6	U	10		1'-4 11/16"	-16.26	-16.26	-16.26	-16.26
Bottom Plate	2x6	AA	1		9'-3 1/2"					Blocking	2x6	V	1		1'-1 7/8"	-16.26	-16.26	-16.26	-16.26
Top Plate	2x6	AB	1		6'-11 1/4"			-16.26	-16.26	Blocking	2x6	W	1		1'-0 9/16"	-16.26	-16.26	-16.26	-16.26
Top Plate	2x6	AC	1		11'-1 11/16"			-16.26	-16.26	Blocking	2x6	X	1		1'-4 1/16"	-16.26	-16.26	-16.26	-16.26
Stud	2x6	A	1		4'-10 5/8"			16.26	16.26	Blocking	2x6	Y	1		10 11/16"	73.74	73.74	-16.26	-16.26
Stud	2x6	B	1		4'-6 3/4"			16.26	16.26										
Stud	2x6	C	1		3'-9 7/16"			16.26	16.26										
Stud	2x6	D	1		3'-4 3/4"			16.26	16.26										
Stud	2x6	E	1		2'-7 7/16"			16.26	16.26										
Stud	2x6	F	1		2'-2 3/4"			16.26	16.26										
Stud	2x6	G	1		1'-5 7/16"			16.26	16.26										
Stud	2x6	H	1		1'-0 3/4"			16.26	16.26										
Stud	2x6	J	1		8 1/8"			16.26	16.26										
Stud	2x6	K	1		3 7/16"			16.26	16.26										
Stud	2x6	L	1		5'-3 3/4"			16.26	16.26										



Whisper Creek

By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Checked By:


MANG.

Wall Location:


Wall #:

FF-CU-09-20-V2

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

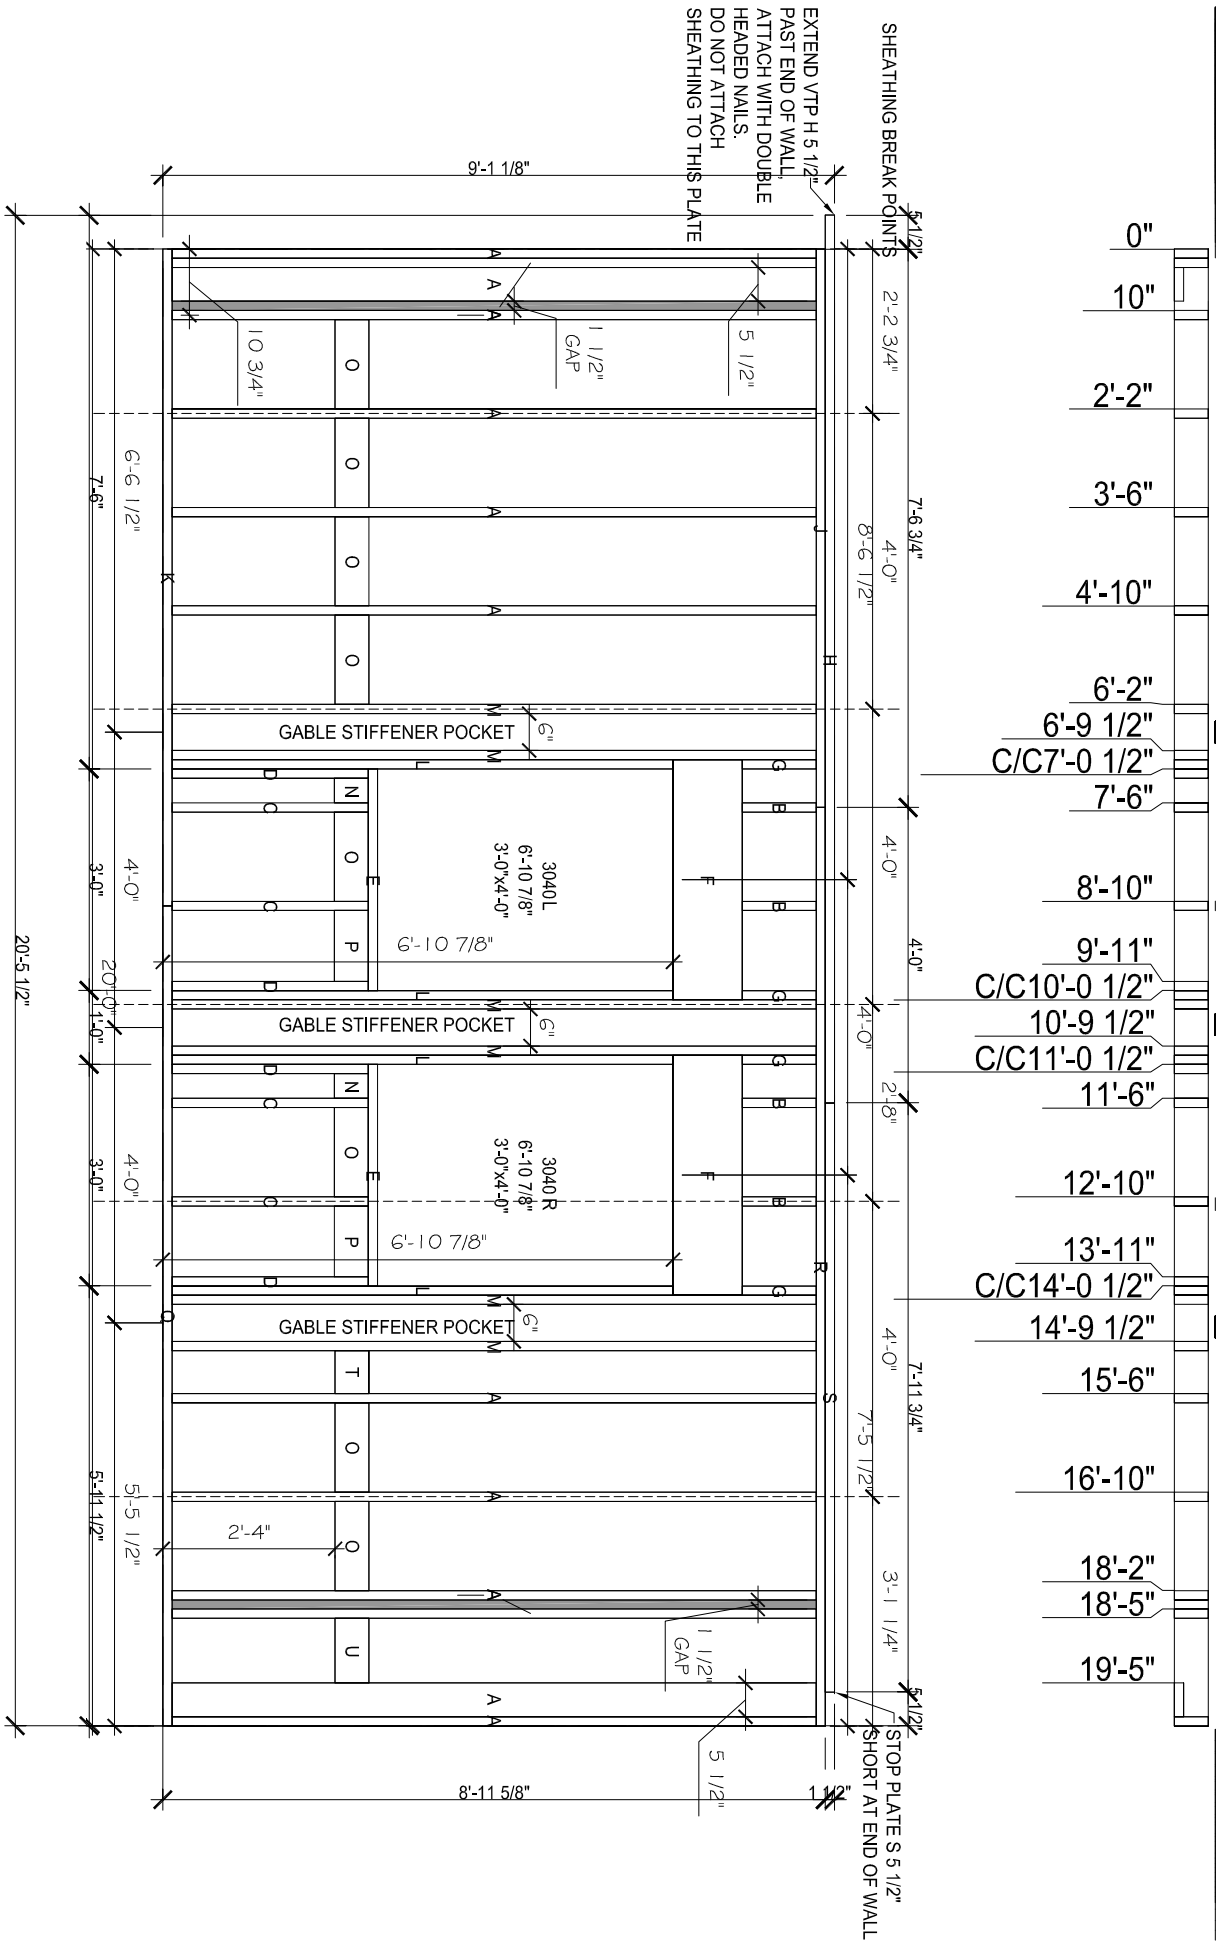

Material (Length is to longest points)						Material (Length is to longest points)					
Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev. 2	Timber	Size
VTP	2x6	H	1		12'-0 1/4"					Blocking	2x6
Top Plate	2x6	J	1		7'-6 3/4"						
Bottom Plate	2x6	K	1		8'-10 3/4"						
Bottom Plate	2x6	Q	1		11'-1 1/4"						
Top Plate	2x6	R	1		12'-5 1/4"						
VTP	2x6	S	1		7'-11 3/4"						
Sill	2x6	E	2		3'-0"						
Sill Cripple	2x6	C	4		2'-7 7/8"						
Hdr Cripple	2x6	B	4		1'-0"						
Stud	2x6	A	13		8'-8 5/8"						
King	2x6	M	6		8'-8 5/8"						
Sill Cripple Filler	1 1/2"x5 1/2"	D	4		2'-7 7/8"						
2-2x12 - Insulation Core	5 1/2"x11 1/4"	F	2		3'-3"						
Hdr Cripple Filler	1 1/2"x5 1/2"	G	4		1'-0"						
Jack Filler	1 1/2"x5 1/2"	L	4		6'-9 3/8"						
Blocking	2x6	N	2		4"						
Blocking	2x6	O	8		1'-2 1/2"						
Blocking	2x6	P	2		11 1/2"						
Blocking	2x6	T	1		7"						

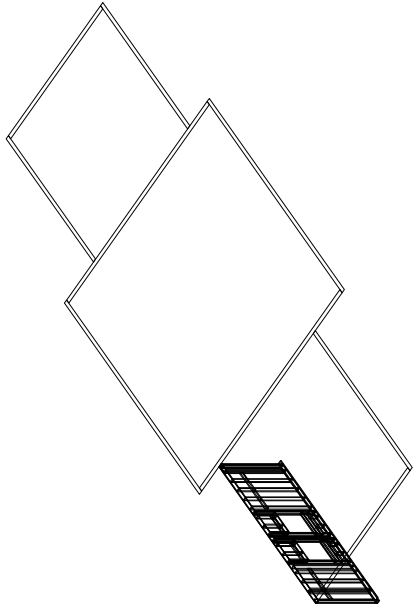

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULT MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL



Whisper Creek

By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Checked By:


MANG.

Wall Location:


Wall #:

G-CW-09-20-V1

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

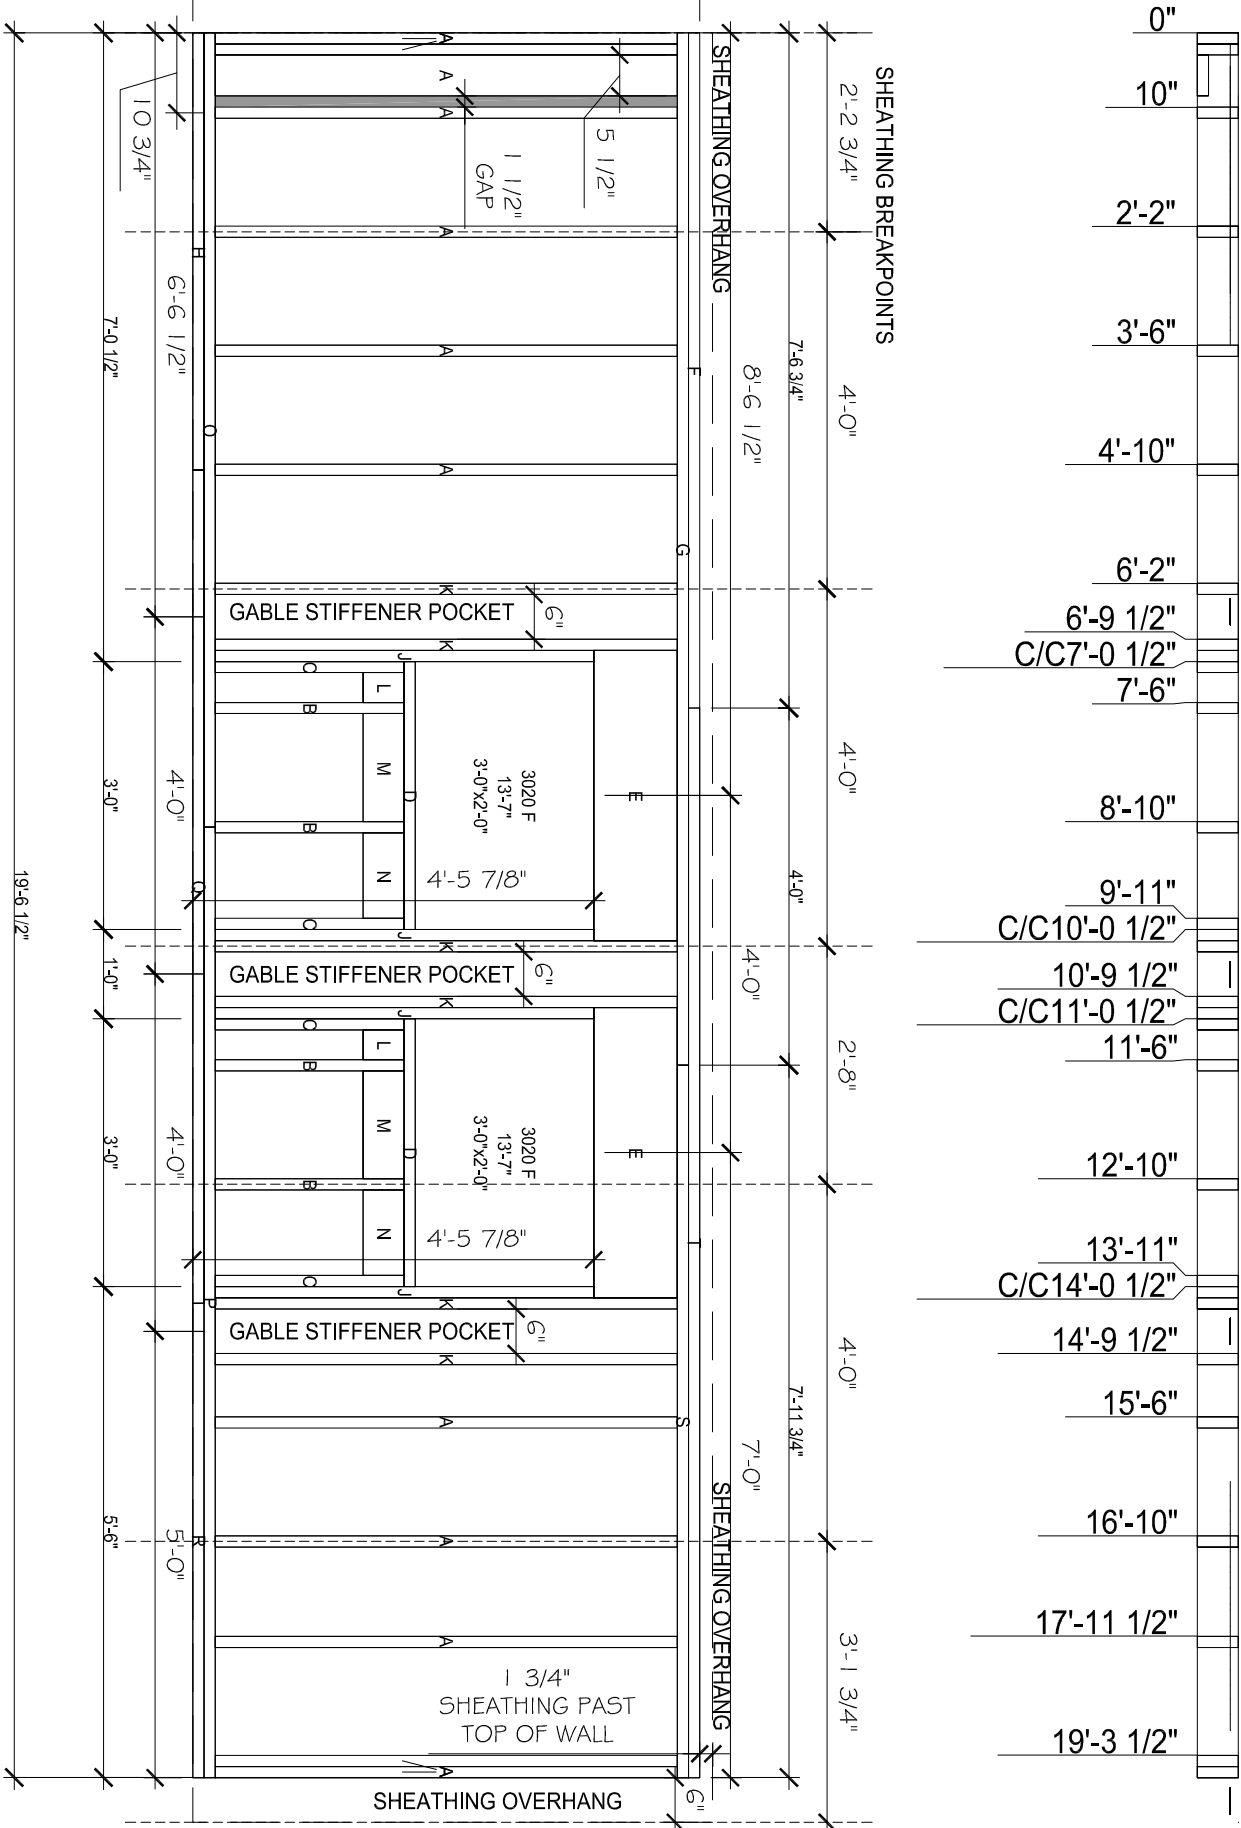

Material (Length is to longest points)					
Timber	Size	Lab.	Qty	No	Length
VTP	2x6	F	1		7'-6 3/4"
Top Plate	2x6	G	1		11'-6 3/4"
Bottom Plate	2x6	H	1		4'-10 3/4"
Bottom Plate	2x6	O	1		8'-10 3/4"
Bottom Plate	2x6	P	1		10'-7 3/4"
Bottom Plate	2x6	Q	1		9'-4"
Bottom Plate	2x6	R	1		5'-3 3/4"
Top Plate	2x6	S	1		7'-11 3/4"
VTP	2x6	T	1		11'-11 3/4"
Sill	2x6	D	2		3'-0"
Sill Cripple	2x6	B	4		2'-1 3/8"
Stud	2x6	A	12		5'-2 1/8"
King	2x6	K	6		5'-2 1/8"
Sill Cripple Filler	1 1/2"x5 1/2"	C	4		2'-1 3/8"
2-2x12 - Insulation Core	5 1/2"x11 1/4"	E	2		3'-3"
Jack Filler	1 1/2"x5 1/2"	J	4		4'-2 7/8"
Blocking	2x6	L	2		4"
Blocking	2x6	M	2		1'-2 1/2"
Blocking	2x6	N	2		11 1/2"

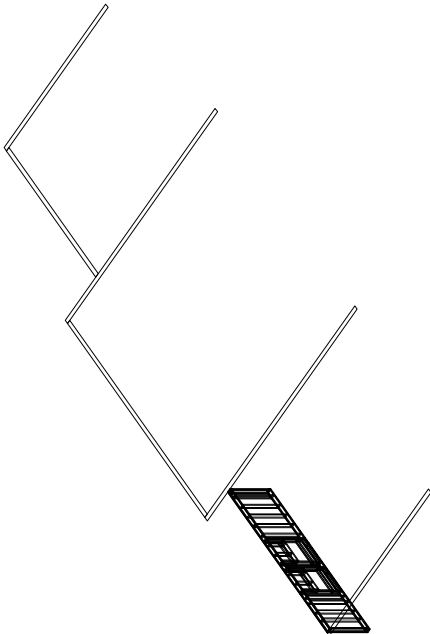

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL



Whisper Creek
By Rocky Mountain Homes

Project #:
7014-000

Project Name:
MEYER

Project Style:

Date:
December 12, 2017


Drawn By:
CRB

Checked By:
MANG.

Wall Location:

Wall #:
GG-CU-09-20-V3

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

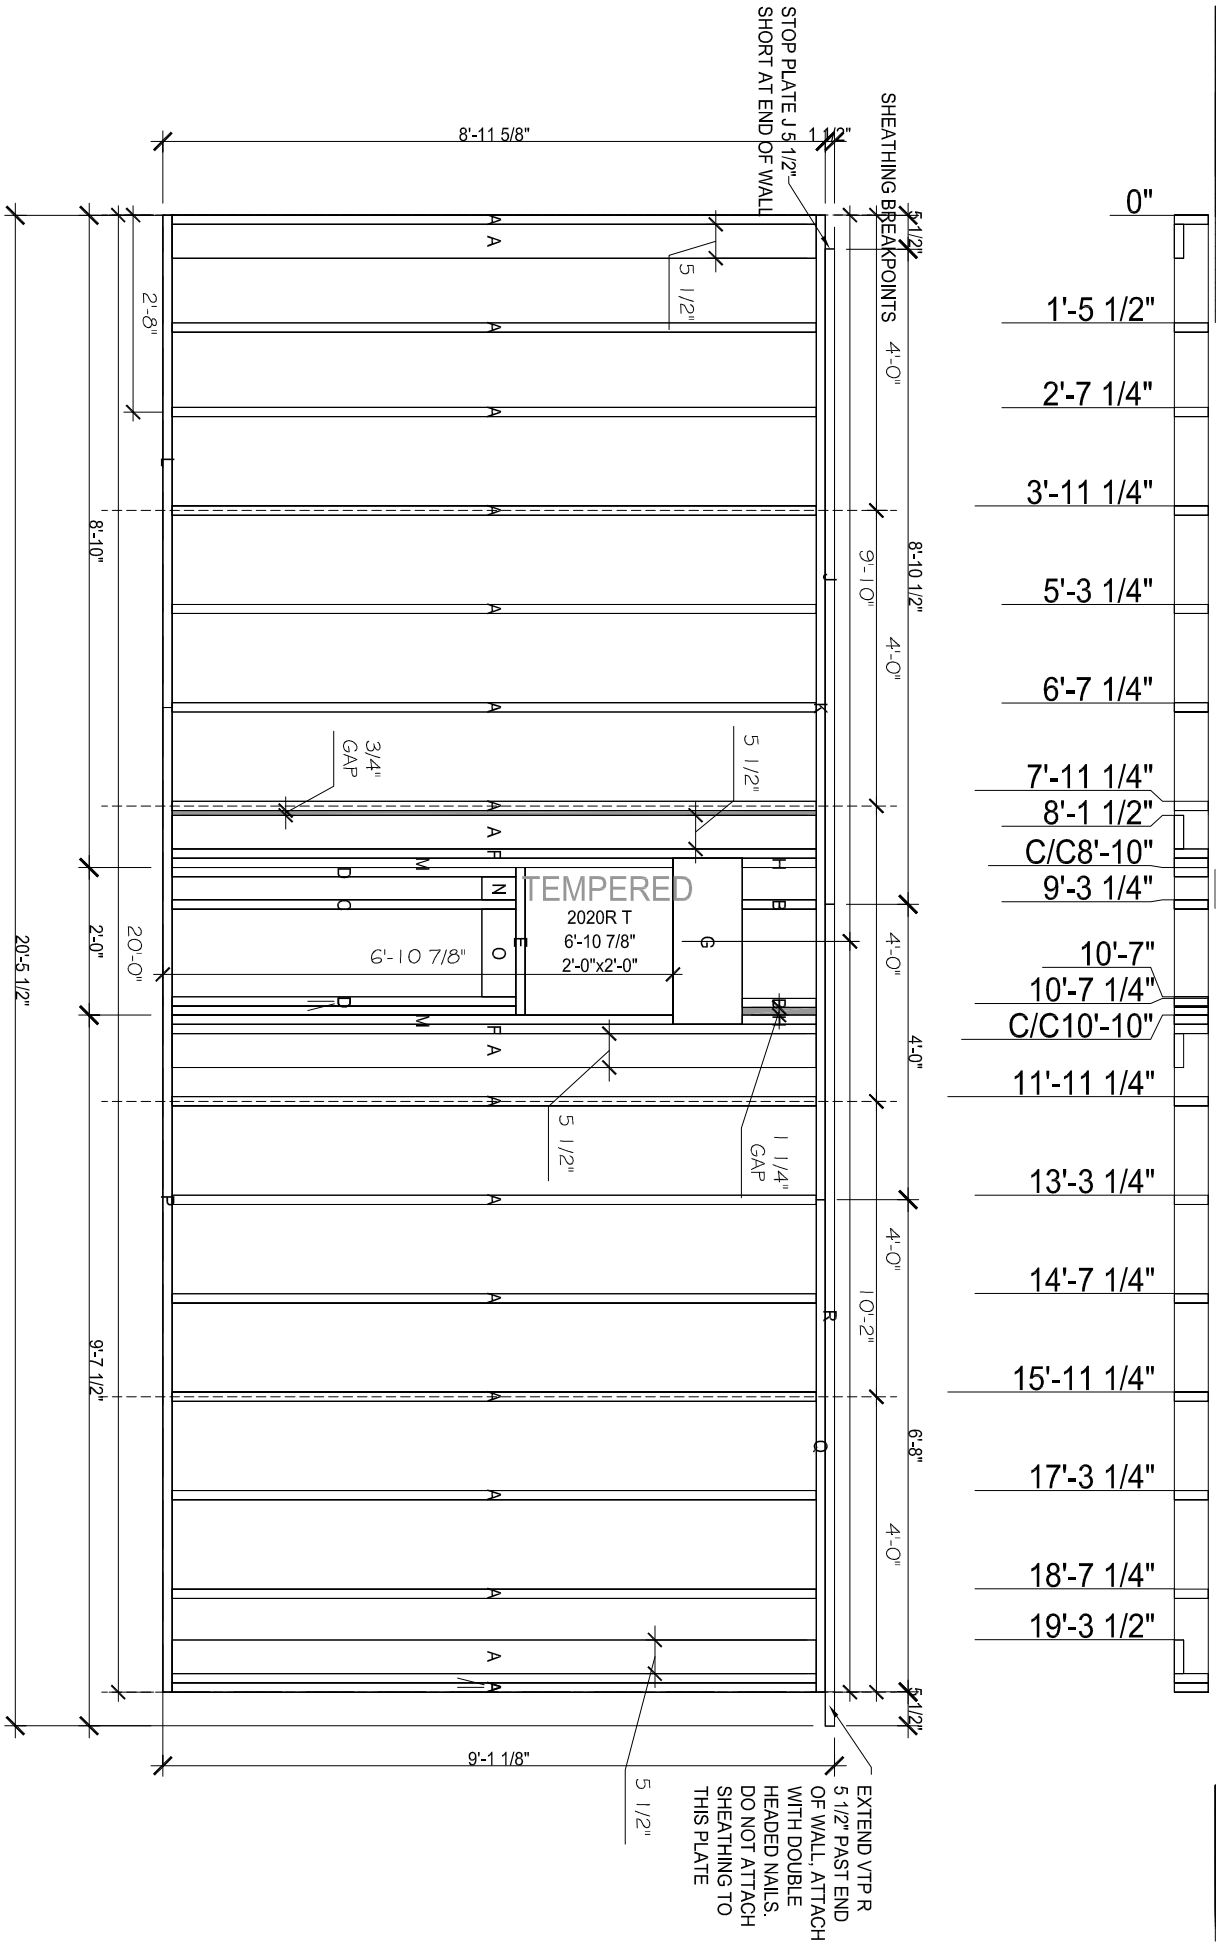

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.


NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULT MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B


ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL

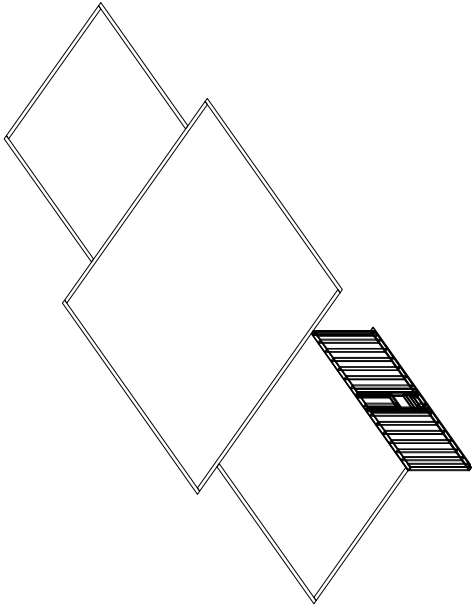


Material (Length is to longest points)					
Timber	Size	Lab.	Qty	No	Length
VTP	2x6	J	1		8'-10 1/2"
Top Plate	2x6	K	1		13'-4"
Bottom Plate	2x6	L	1		6'-8"
Bottom Plate	2x6	P	1		13'-4"
Top Plate	2x6	Q	1		6'-8"
VTP	2x6	R	1		11'-1 1/2"
Sill	2x6	E	1		2'-0"
Sill Cripple	2x6	C	1		4'-7 7/8"
Hdr Cripple	2x6	B	2		1'-0"
Stud	2x6	A	19		8'-8 5/8"
Sill Cripple Filler	1 1/2"x5 1/2"	D	3		4'-7 7/8"
King Filler	1 1/2"x5 1/2"	F	2		8'-8 5/8"
2-2x12 - Insulation Core	5 1/2"x11 1/4"	G	1		2'-3"
Hdr Cripple Filler	1 1/2"x5 1/2"	H	2		1'-0"
Jack Filler	1 1/2"x5 1/2"	M	2		6'-9 3/8"
Blocking	2x6	N	1		3 3/4"
Blocking	2x6	O	1		1'-2 1/4"

 Whisper Creek By Rocky Mountain Homes	Project #: 7014-000		Date: December 12, 2017	
	Project Name: MEYER	Drawn By: CRB	Wall Location:	Wall #: H-CW-09-20-V2
	Project Style:	Checked By: MANG.		

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

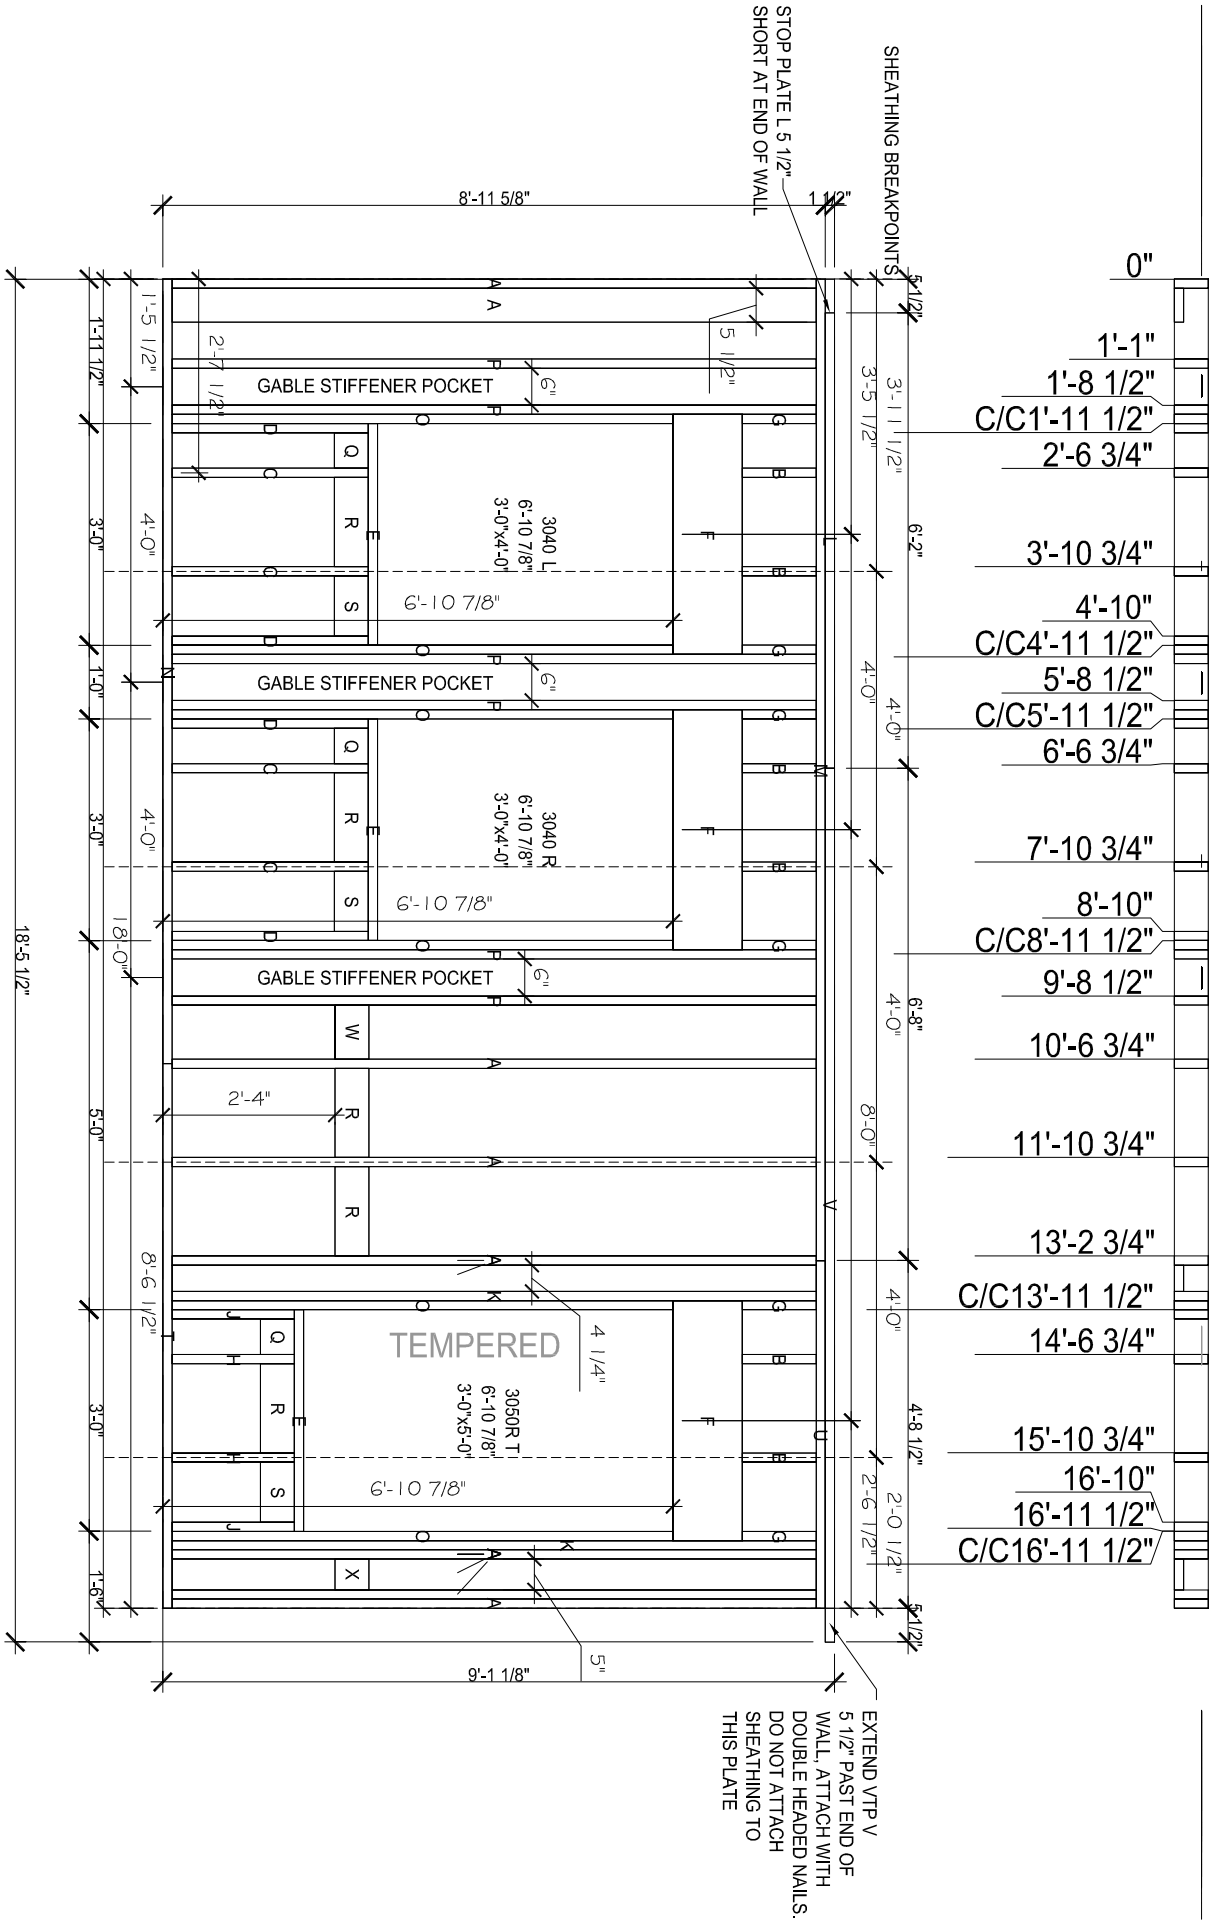

Material (Length is to longest points)						Material (Length is to longest points)					
Timber	Size	Lab.	Qty	No	Length	Cut 1	Bev. 1	Cut 2	Bev.2	Timber	Size
VTP	2x6	L	1		6'-2"					Blocking	2x6
Top Plate	2x6	M	1		13'-3 1/2"					Blocking	2x6
Bottom Plate	2x6	N	1		10'-7 1/2"					Blocking	2x6
Bottom Plate	2x6	T	1		7'-4 1/2"					Blocking	2x6
Top Plate	2x6	U	1		4'-8 1/2"						
VTP	2x6	V	1		11'-10"						
Sill	2x6	E	3		3'-0"						
Sill Cripple	2x6	C	4		2'-7 7/8"						
Sill Cripple	2x6	H	2		1'-7 7/8"						
Hdr Cripple	2x6	B	6		1'-0"						
Stud	2x6	A	10		8'-8 5/8"						
King	2x6	P	6		8'-8 5/8"						
Sill Cripple Filler	1 1/2"x5 1/2"	D	4		2'-7 7/8"						
2-2x12 - Insulation Core	5 1/2"x11 1/4"	F	3		3'-3"						
Hdr Cripple Filler	1 1/2"x5 1/2"	G	6		1'-0"						
Sill Cripple Filler	1 1/2"x5 1/2"	J	2		1'-7 7/8"						
King Filler	1 1/2"x5 1/2"	K	2		8'-8 5/8"						
Jack Filler	1 1/2"x5 1/2"	O	6		6'-9 3/8"						
Blocking	2x6	Q	3		5 3/4"						

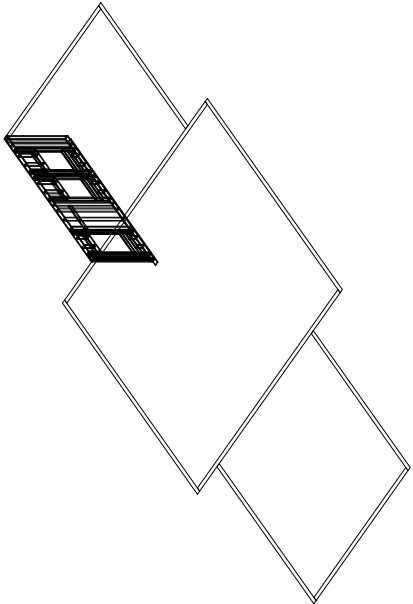

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL



Whisper Creek

By Rocky Mountain Homes

Project #:

7014-000

Project Name:

MEYER

Project Style:

Date:

December 12, 2017

Drawn By:

CRB

Checked By:



MANG.

Wall Location:

Wall #:

I-CW-09-18-V3

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

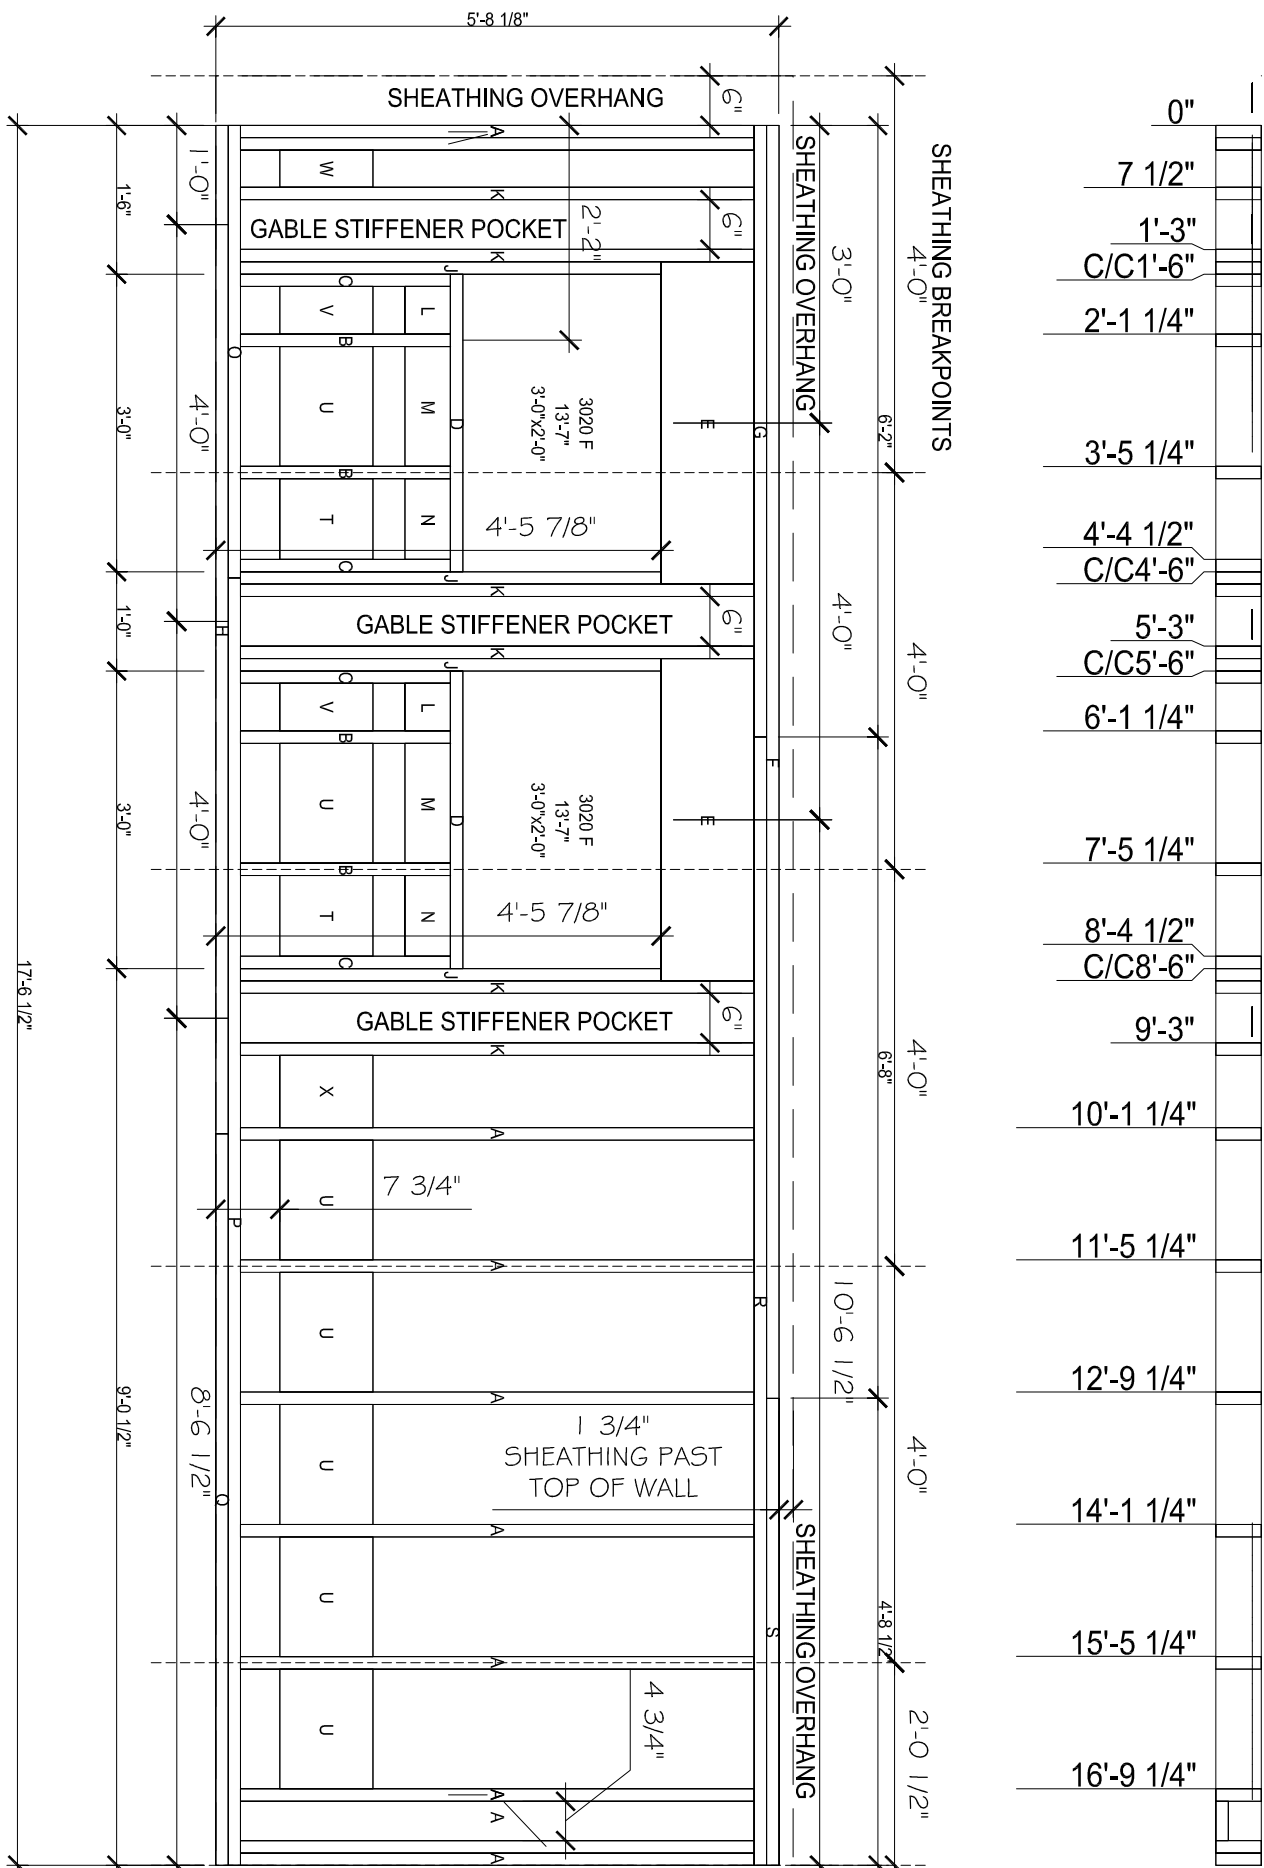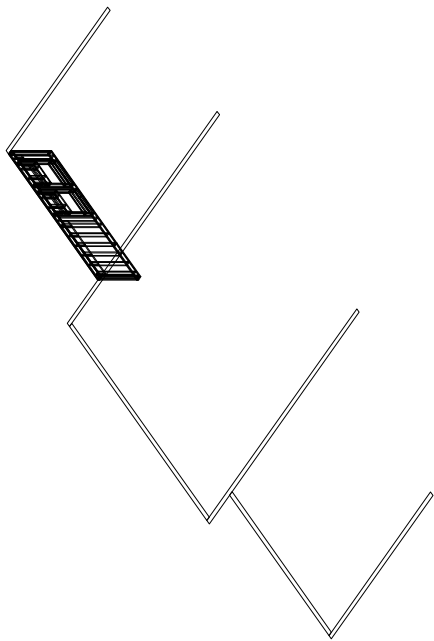[illegible]

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON THE EDGES AND 12" ON THE FIELD, U.N.O. STAGGER NAILS @ PANEL EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED


ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY DIFFERENCE BY .01 OF A DEGREE

FOR MULT MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B


ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING PAPER 6" BELOW BOTTOM OF THE WALL

	Project #:	7014-000	Date:	December 12, 2017	
	Project Name:	MEYER	Drawn By:	Wall Location:	Wall #:
	Project Style:		CRB		
			Checked By:		II-CU-09-18-V4
			MANG.		

VERIFY 1ST AND 2ND BAYS, EACH END OF WALL, MAY NOT BE ON STUD LAYOUT, ALL WALLS

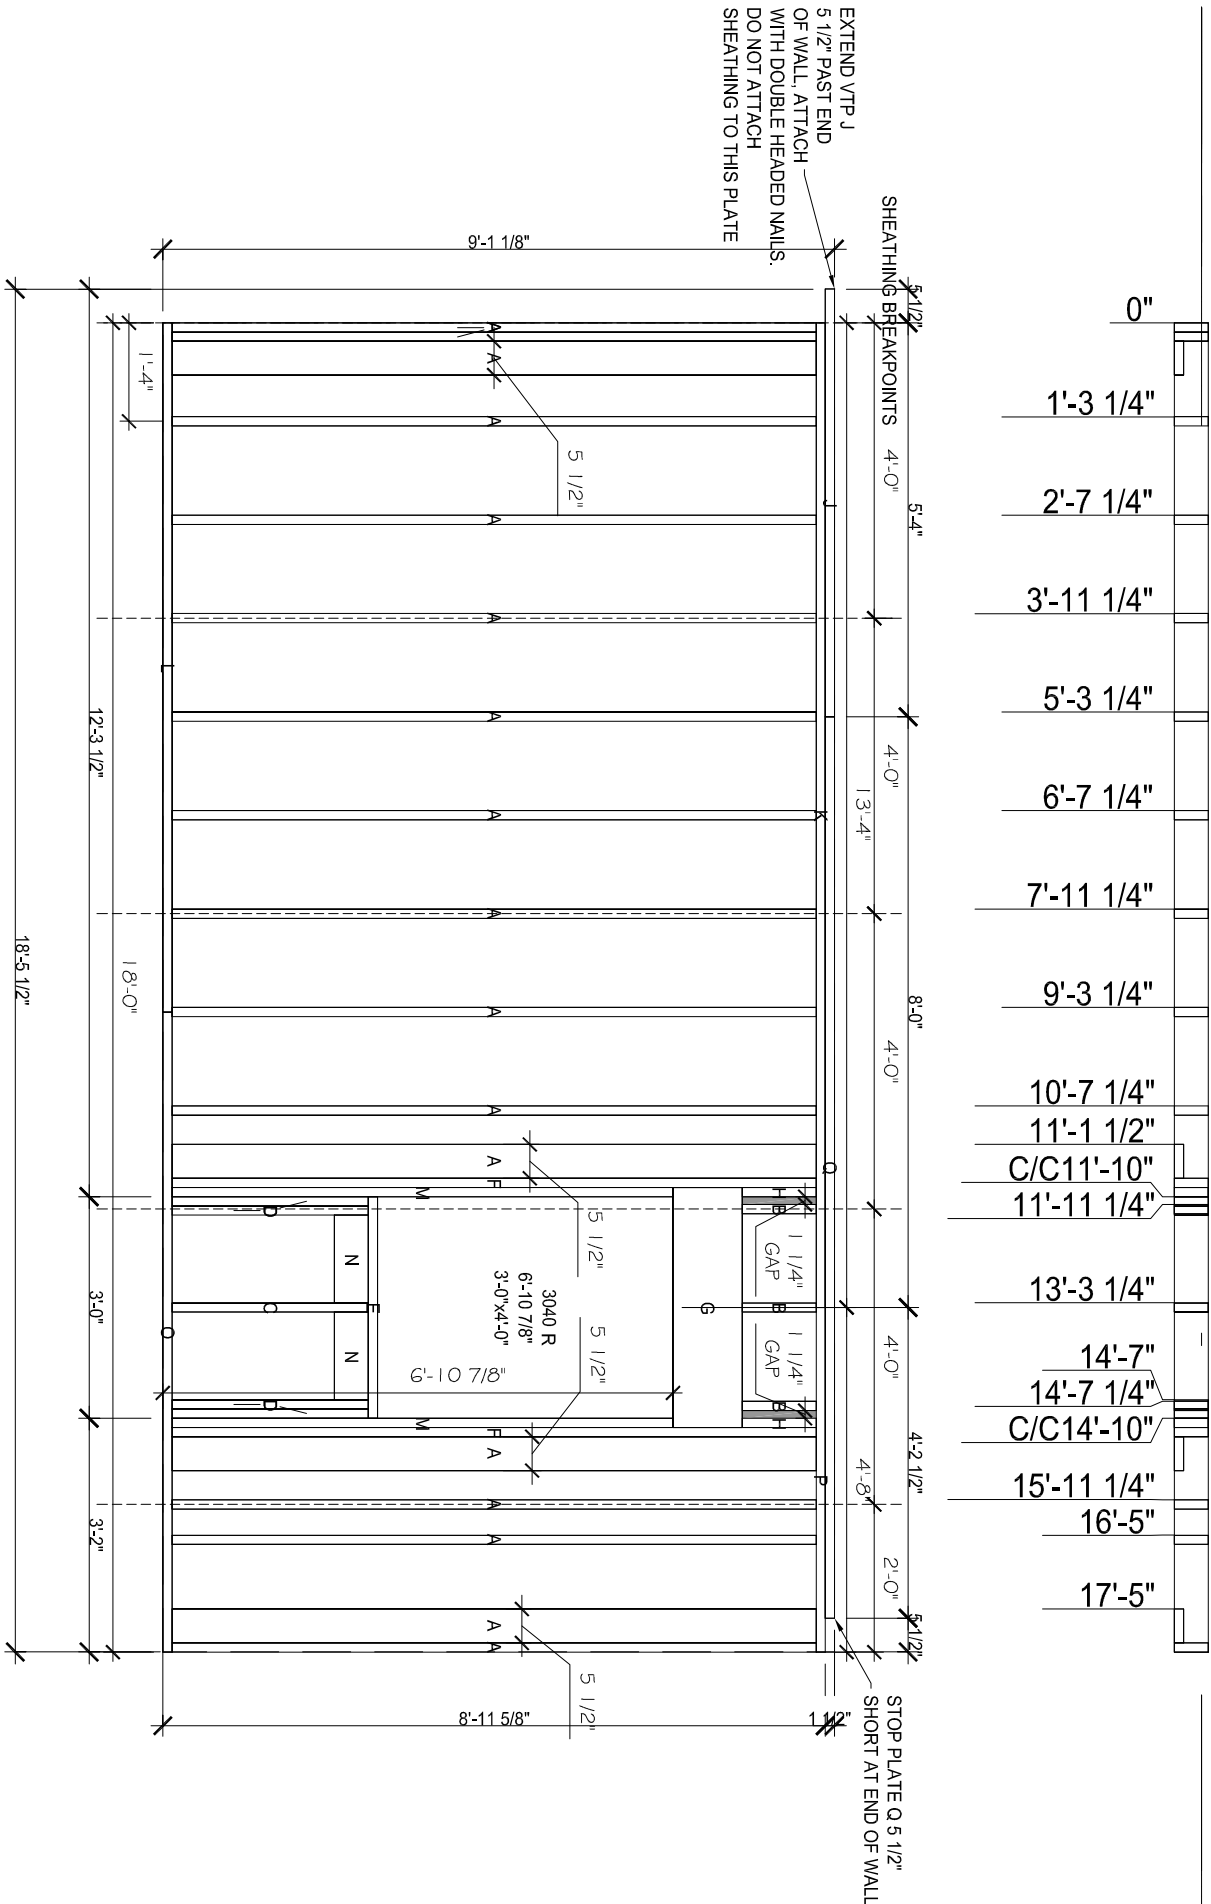

Material (Length is to longest points)						
Timber	Size	Lab.	Qty	No	Length	
VTP	2x6	J	1		5'-9 1/2"	Cut 1
Top Plate	2x6	K	1		13'-4"	Bev. 1
Bottom Plate	2x6	L	1		9'-4"	Cut 2
Bottom Plate	2x6	O	1		8'-8"	Bev.2
Top Plate	2x6	P	1		4'-8"	
VTP	2x6	Q	1		12'-2 1/2"	
Sill	2x6	E	1		3'-0"	
Sill Cripple	2x6	C	1		2'-7 7/8"	
Hdr Cripple	2x6	B	3		1'-0"	
Stud	2x6	A	17		8'-8 5/8"	
Sill Cripple Filler	1 1/2"x5 1/2"	D	4		2'-7 7/8"	
King Filler	1 1/2"x5 1/2"	F	2		8'-8 5/8"	
2-2x12 - Insulation Core	5 1/2"x11 1/4"	G	1		3'-3"	
Hdr Cripple Filler	1 1/2"x5 1/2"	H	2		1'-0"	
Jack Filler	1 1/2"x5 1/2"	M	2		6'-9 3/8"	
Blocking	2x6	N	2		1'-2 1/4"	

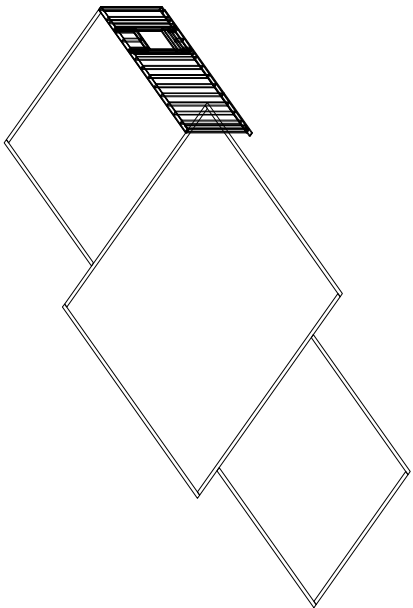

NOTE: SOME FACE STUDS NEED TO BE
RIPPED DOWN TO FIT BETWEEN STUDS.
WIDTHS ARE DIMENSIONED ON WALL
LAYOUT.

NOTES: ALL STUDS TO BE 2X6 HEM-FIR #2 OR BETTER UNLESS
OTHERWISE NOTED. NAILING PATTERN FOR SHEATHING TO BE 3" ON
THE EDGES AND 12" ON THE FIELD. U.N.O. STAGGER NAILS @ PANEL
EDGES. NAILS ARE TO BE DRIVEN FLUSH W/ TOP OF SHEETING. DO
NOT OVERDRIVE NAILS. SHEATHING IS TO BE 7/16" APA RATED
STRUCTURAL SHEATHING U.N.O.

(2) 2X6 STUDS TO BE FACED NAILED WITH 10d EACH FACE @ 3" O.C.
STAGGERED

ALL CUTS SHOULD BE 90, 16.26 OR 73.74 DEGREES, DISREGARD ANY
DIFFERENCE BY .01 OF A DEGREE

FOR MULTI MEMBER BEAM OR HEADER NAIL WITH 16d @ 12" O.C.
EACH SIDE, EACH LAYER
-STAGGERED T&B

ON GABLES, GABLE CAPS, & DORMER FRONTS EXTEND BUILDING
PAPER 6" BELOW BOTTOM OF THE WALL

	Project #:	7014-000	Date:	December 12, 2017	Wall #:	J-CW-09-18-V4
	Project Name:	MEYER	Drawn By:	CRB		
	Project Style:		Checked By:	MANG.		